

*Drinking Water Engineering and Science Discussions* is the access reviewed discussion forum of *Drinking Water Engineering and Science*

# Correlations between total cell concentration, total adenosine tri-phosphate concentration and heterotrophic plate counts during microbial monitoring of drinking water

E. Siebel<sup>1</sup>, Y. Wang<sup>1,2</sup>, T. Egli<sup>1,2</sup>, and F. Hammes<sup>1</sup>

<sup>1</sup>Swiss Federal Institute of Aquatic Science and Technology (Eawag), Überlandstr. 133, 8600 Dübendorf, Switzerland

<sup>2</sup>Institute of Biogeochemistry and Pollutant Dynamics, ETH Zürich, 8092 Zürich, Switzerland

Received: 31 January 2008 – Accepted: 6 February 2008 – Published: 11 February 2008

Correspondence to: F. Hammes (frederik.hammes@eawag.ch)

Published by Copernicus Publications on behalf of the Delft University of Technology.

---

**Correlations between  
methods to assess  
microbial water  
quality**

E. Siebel et al.

---

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

## Abstract

The general microbial quality of drinking water is normally monitored by heterotrophic plate counts (HPC). This method has been used for more than 100 years and is recommended in drinking water guidelines. However, the HPC method is significantly handicapped because it is time-consuming and restricted to culturable bacteria. Recently, rapid and accurate detection methods have emerged, such as adenosine tri-phosphate (ATP) measurements to assess microbial activity in drinking water, and flow cytometry (FCM) to determine the total cell concentration (TCC). It is necessary and important for drinking water quality control to understand the relationships among the conventional and new methods. In the current study, all three methods were applied to 200 drinking water samples obtained from two local buildings connected to the same distribution system. Samples were taken both on normal working days and weekends, and the correlations between the different microbiological parameters were determined. The results showed that the rapid determination methods (i.e., FCM and ATP) correlated significantly ( $R^2=0.69$ ), but only a weak correlation ( $R^2=0.31$ ) was observed between the rapid methods and conventional HPC data. With respect to drinking water monitoring, both FCM and ATP measurements were confirmed to be useful and complimentary parameters for rapid assessing of drinking water microbial quality.

## 1 Introduction

For more than 100 years, microbial characterization of drinking water has relied on heterotrophic plate counts (HPC) (Sartory, 2004). This method is used world-wide for monitoring drinking water quality in the distribution network and for assessing the efficacy of treatment steps (Allen et al., 2004; Reasoner and Geldreich, 1985). In Switzerland the statutory limit of HPC bacteria has been set to 20 colony forming units per ml (CFU/ml) after treatment, and to 300 CFU/ml within the distribution system (HyV, 2006; SLMB, 2000), which concurs with world-wide accepted guidelines (WHO, 2006).

DWESD

1, 71–86, 2008

## Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Despite the common usage of HPC, it is reported that HPC bacterial numbers can vary widely in drinking water distribution networks (Allen et al., 2004; Pepper et al., 2004). It has been discussed previously that HPC results are influenced by various factors such as cultivation media, incubation temperature and the selective culturability of natural bacteria (Hammes et al., 2008; Sartory, 2004). Moreover, the HPC method is time-consuming, requiring usually 3–7 days before results are available. There is thus a niche for the development of rapid, easy and accurate methods to quantify bacteria in drinking water.

The development of fluorescent staining methods facilitated the accurate measurement of the total cell concentration (TCC) with epi-fluorescence microscopy, laser-scanning microscopy and flow cytometry (Rinta-Kanto et al., 2004; Hammes et al., 2008). The ability to enumerate the complete bacterial cell concentration has revealed a huge discrepancy between concentrations of cells detected with conventional HPC and with TCC methods in aquatic environments. TCC measurement with flow cytometry has clear benefits: it is fast, highly reproducible and it detects all bacteria irrespective of their culturability (Hammes et al., 2008). We have also previously demonstrated the value of this parameter when describing microbial events that occur during drinking water treatment (Hammes et al., 2008). An alternative method gaining prominence is adenosine tri-phosphate (ATP) measurements. It is a rapid and easy method for the detection of viable bacteria in drinking water (Hammes et al., 2008) and has previously been correlated to conventional HPC data (Deininger and Lee, 2001; Delahaye et al., 2003). However, ATP is not yet widely used in the drinking water industry, due to a lack of knowledge on average ATP concentrations in natural bacteria. This is needed to understand ATP measurements and to correlate ATP data to biomass. For new methods to gain acceptance amongst practitioners, it is essential to understand the relationship (if there is any) among the various methods.

In this study, flow cytometric TCC measurements were compared with total ATP measurements and HPC data on tap water that does not contain disinfectant residuals. All three methods were applied on a local drinking water distribution system in

**Correlations between methods to assess microbial water quality**

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

two separate office buildings during a normal working day and a weekend day. Their correlations were determined and evaluated.

## 2 Materials and methods

### 2.1 Sampling

5 Drinking water samples were collected from two buildings at our research facility (Eawag, Dübendorf, Switzerland). Sampling from both buildings took place on two separate days, one working day (Wednesday) and one weekend day (Sunday) to observe the effect of regular and non-regular usage. Samples were taken from 8 a.m. to 5 p.m. at one hour intervals and at 8 a.m. on the following morning to account for  
10 temporal changes during a day. Tap water from 10 separate floors in both buildings was sampled directly into sterile 15 ml Falcon tubes without any prior water flushing. Samples were processed directly after sampling.

### 2.2 Flow cytometric total cell counts measurements

To measure the total cell counts (TCC), 900  $\mu$ l of the water sample was stained with  
15 9  $\mu$ l of SYBR Green I nucleic acid stain (1:100 diluted in filtered DMSO; Invitrogen™, Oregon, USA) and incubated in the dark for 10 min before measuring with a Partec CyFlow Space flow cytometer (Partec GmbH, Münster, Germany). Flow cytometric measurements were performed as described previously (Hammes et al., 2008). The Partec CyFlow Space is equipped with a volumetric counting hardware with a measured  
20 quantification limit of <1000 cells/ml (Hammes et al., 2008). TCC were also determined separately for two specific FCM clusters, namely the so-called low (LNA) and high (HNA) nucleic acid content bacteria, as described by Lebaron et al. (2001) and Gasol et al. (1999) (see also Fig. 1).

---

## Correlations between methods to assess microbial water quality

E. Siebel et al.

---

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

## 2.3 Total ATP concentration

Total ATP concentration was determined as described in Berney et al. (2006) using the Promega Bac Titer-Glo Microbial Cell Viability Assay (Promega Corporation, Madison, WI, USA). All samples were measured in triplicate. A standard curve with dilutions of a known rATP standard (Promega Corporation) was completed before the experiments and the total ATP concentration was calculated based on the standard curve. ATP-per-cell was calculated from total ATP measurements and flow cytometry measurements as follows:

$$\text{ATP-per-cell (g/cell)} = \frac{\text{total ATP concentration (g/L)}}{\text{cell concentration (cells/L)}} \quad (1)$$

## 2.4 Heterotrophic plate counts (HPC)

HPC was performed according to the Swiss guidelines for drinking water (SLMB, 2000). In short, PCA agar plates (BBL Standard Methods Agar, MD, USA) were prepared following instructions provided by the manufacturer. Serial dilutions of the water samples were done in decimal steps in sterile 0.9% NaCl solution. 100  $\mu$ l of the sample were spread-plated from two dilutions ( $10^0$  and  $10^{-1}$ ), each in triplicate, to assess methodological variation. The plates were incubated at 30°C for 72 h. Colony forming units (CFU) were counted with an automatic plate reader (aCOLyte, SYNBIOSIS, Cambridge, UK).

## 3 Results and discussion

### 3.1 Overview of the measurements with different methods

Flow cytometric (FCM) measurements have been used effectively before to characterize bacteria in drinking water (Hoefel et al., 2003; Hammes et al., 2008). In our study,

DWESD

1, 71–86, 2008

**Correlations between  
methods to assess  
microbial water  
quality**

E. Siebel et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



a total of 200 samples were collected and analyzed from two buildings over four separate days. Total cell concentrations (TCC) from the drinking water samples varied in the range of  $0.37\text{--}5.61 \times 10^5$  cells/ml. The average TCC was  $1.49(\pm 0.91) \times 10^5$  cells/ml, which concurs with previous data reported for Swiss drinking water (Hammes et al., 2008). In general, if a tap was used frequently, TCC numbers were low, but slight changes in bacterial concentrations could still be detected. In all samples analyzed, two specific bacterial clusters were observed on two dimensional FCM dot-plots, distinguished by size (as measured with sideward scattered (SSC) light) and green fluorescence intensity (520 nm) (Fig. 1). These two clusters represent the so-called low (LNA) and high (HNA) nucleic acid content bacteria, which have been commonly observed in seawater and freshwater with flow cytometry (Gasol et al., 1999; Lebaron et al., 2001). The concentrations of LNA and HNA bacteria in each sample were also counted separately. HNA bacteria, which previously have been related to microbial activity (Lebaron et al., 2001), represented usually about 60% of the TCC (data not shown) and throughout the study the HNA/LNA ratio remained constant, irrespective of the tap location, sampling time or TCC variation. The standard deviation on triplicate FCM measurements was always below 5%, which is similar to former studies and underlines the high reproducibility of flow cytometric TCC measurements (Hammes et al., 2008; Hammes and Egli, 2005).

An alternative method for the characterization of bacteria in drinking water is adenosine tri-phosphate (ATP) measurements (Deininger et al., 2001; Delahaye et al., 2003; Hammes et al., 2008). This method is rapid and easy to perform and its instrumentation is rather affordable. The total ATP concentration for all samples was in the range of  $0.005\text{--}0.094$  nM ATP and the average ATP concentration was  $0.023 (\pm 0.017)$  nM ATP. Based on the TCC from flow cytometric measurements, the average cellular ATP content was calculated (Eq. 1) and the results varied from  $0.05\text{--}2.09 \times 10^{-16}$  g ATP/cell with an average of  $6.87(\pm 1.42) \times 10^{-17}$  g ATP/cell, which is comparable to previously reported values for natural communities in drinking water (Frundzhyan and Ugarova, 2007; Hammes et al., 2008; Velten et al., 2007). The advantage of having an average

---

## Correlations between methods to assess microbial water quality

E. Siebel et al.

---

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[⏪](#)[⏩](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

ATP-per-cell value is that it can be used for converting ATP data to bacterial concentrations. However, it is noted that the value reported in this study makes the broad assumption that all the cells detected with FCM were alive and containing a similar ATP concentration. With respect to reproducibility, the average standard deviation of all the ATP data was 13%, which is close to deviation values in other studies (Hammes et al., 2008; Velten et al., 2007).

Conventional heterotrophic plate counts (HPC) results were on average two orders of magnitude lower than the TCC from flow cytometric measurements. No more than 8.6% (average 1.6%) of the TCC were detected with HPC. The average concentration of HPC was  $2.28(\pm 0.32) \times 10^3$  CFU/ml. Heterotrophic bacteria usually form a fraction below 1% of total cell counts (van der Kooij, 2003; Hammes et al., 2008). Based on this value and referring to the Swiss guidelines of 300 CFU/ml for drinking water (HyV, 2006; SLMB, 2000), the obtained values were about 10-times higher in this particular distribution system than expected. The reason for such an increase might be regrowth; both planktonic and biofilm bacteria within the building's distribution system and also individual taps might affect the water quality (Pepper et al., 2004; van der Kooij, 2003). The average standard deviation of 14% is reasonable, but significantly higher compared to a constant error below 5% in flow cytometric TCC measurements.

### 3.2 Data from one representative tap

The changes and relationships among all three parameters from one representative tap of Building 1 during a normal working day are shown in Fig. 2. A rapid decrease in TCC and HPC along with the total ATP concentration was observed. It is evident that all three methods rendered the highest values at 8 a.m., which is attributed to regrowth during overnight stagnation in the tap. All values decreased until 10 a.m., linked to regular use of the taps before stabilizing during the day and again increasing overnight. In this example, the HPC did not increase as much overnight as the other parameters. All three methods from this specific tap showed a very similar pattern and significant correlations as well. The best correlation was between the TCC and ATP concentra-

## Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



tions ( $R^2=0.96$ ;  $n=11$ ), while correlations between HPC and TCC ( $R^2=0.72$ ) and HPC and ATP ( $R^2=0.56$ ) were also recorded. These results showed that both rapid methods (TCC and ATP) can detect the similar pattern as the conventional HPC method, but with the clear advantage of being fast, accurate and reproducible. Additionally we observed that small changes in HPC data were also detected by flow cytometry even though there were two orders of magnitude difference in the actual values (Fig. 2). However, it should be pointed out that Fig. 2 exemplifies an ideal course of data points. Results from other floors had often more variations in daily changes, and amongst the various parameters.

### 3.3 Overall correlations among the three different parameters

Despite of the above-mentioned differences between the different buildings, floors and sampling days, the overall TCC and ATP data correlated very well with each other ( $R^2=0.69$ ) and had a high statistical significance ( $p \ll 0.001$ ;  $n=200$ ) when all data were considered (Fig. 3). However, there is also an apparent difference between the TCC and ATP measurements. This may lead to a general question such as: why would ATP correlate or not correlate with TCC? Most likely, ATP would correlate well with TCC if most of the cells are alive and contain similar amounts of ATP, expecting a correlation coefficient close to 1. Evidently this is not the case and can be explained with various reasons. The uncertainty of ATP measurements ( $R^2=0.69 \neq 1$ ) towards TCC is probably not related to the error of either method, but occurs because different bacterial species and different viability states of bacterial cells could influence individual cellular ATP concentrations. In fact, in a separate study we have shown that an even better correlation is found between ATP and the fraction of esterase-positive (CFDA-stained) cells in drinking water<sup>1</sup>. Nevertheless, the combination of TCC and ATP methods gives a complementary overall picture of the microbial quality in the drinking water distribution system.

<sup>1</sup>Berney et al., manuscript in preparation.

## Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)





Furthermore, we have also observed a similar overall correlation between HNA bacteria and ATP ( $R^2=0.67$ ) (Table 1). It has been suggested that the HNA fraction gives a representation of the active bacterial population in a water sample (Gasol et al., 1999; Lebaron et al., 2001). The fact that the correlation with ATP has not improved when compared to HNA (opposed to TCC), contradicts this opinion to some extent, and suggests that a mere HNA/LNA flow cytometric separation might be inadequate to interpret bacterial viability and activity in a drinking water sample. In addition, the consistent presence of LNA bacteria at high cell concentrations (40% of TCC) in the drinking water distribution system, indicates that this group of bacteria may also contribute to the bacterial activity.

In comparison with the strong correlation between TCC and ATP, correlation coefficients between HPC vs. ATP ( $R^2=0.31$ ) and HPC vs. TCC ( $R^2=0.36$ ) were significantly lower, also when the data were separated to track possible distinctive changes day-wise and/or building-wise (Table 1). The correlation between ATP and HPC ( $R^2=0.31$ ; Fig. 4) is similar to that reported by Delahaye et al. (2003) even though different cultivation methods were used in the latter study. Both the studies of Delahaye et al. (2003) and Deininger and Lee (2001) concluded that rapid ATP measurement is a valuable drinking water parameter, based on the correlation thereof to conventional HPC data. Though our study comes to the same conclusion about ATP measurements, the data presented in Fig. 3, 4 and Table 1 clearly suggest that ATP correlates more accurately to TCC than to HPC. We believe that this is a direct result of the selective nature of the HPC method, where only a small percentage of the viable (and thus ATP-containing) bacteria in a water sample can be cultivated on synthetic media under selective laboratory-defined conditions (Hammes et al., 2008)

## 4 Conclusions

Rapid enumeration methods are crucial for drinking water quality monitoring. Flow cytometry and total ATP measurements are both sensitive and rapid methods that can be

### Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



performed easily without the handicap of a selective trait such as culturability. In comparison, the enumeration of heterotrophic bacteria is obviously more time and labour consuming. We have found that there is a strong correlation between TCC and the ATP data. Therefore, application of both methods simultaneously forms a powerful combination of rapid and accurate microbial characterization of drinking water.

*Acknowledgements.* The authors kindly acknowledge financial assistance from the Eawag Wave21 project and the 6th EU framework project TECHNEAU (018320).

## References

Allen, M. J., Edberg, S. C., and Reasoner, D. J.: Heterotrophic plate count bacteria - what is their significance in drinking water?, *Int. J. Food Microbiol.*, 92(3), 265–274, 2004.

Berney, M., Weilenmann, H. U., and Egli, T.: Flow-cytometric study of vital cellular functions in *Escherichia coli* during solar disinfection (SODIS), *Microbiol.-SGM*, 152, 1719–1729, 2006.

Deininger, R. A. and Lee, J.: Rapid determination of bacteria in drinking water using an ATP assay, *Field Anal. Chem. Tech.*, 5(4), 185–189, 2001.

Delahaye, E., Welte, B., Levi, Y., Leblon, G., and Montiel, A.: An ATP-based method for monitoring the microbiological drinking water quality in a distribution network, *Water Res.*, 37(15), 3689–3696, 2003.

Frundzhyan, V. and Ugarova, N.: Bioluminescent assay for total bacterial contamination of drinking water, *Luminescence*, 22, 241–244, 2007.

Gasol, J. M., Zweifel, U. L., Peters, F., Fuhrman, J. A., and Hagstrom, A.: Significance of size and nucleic acid content heterogeneity as measured by flow cytometry in natural planktonic bacteria, *Appl. Environ. Microb.*, 65(10), 4475–4483, 1999.

Hammes, F., Berney, M., Wang, Y., Vital, M., Köster, O., and Egli, T.: Flow-cytometric total bacterial cell counts as a descriptive microbiological parameter for drinking water treatment processes, *Water Res.*, 42(1–2), 269–277, 2008.

Hammes, F. A. and Egli, T.: New method for assimilable organic carbon determination using flow-cytometric enumeration and a natural microbial consortium as inoculum, *Environ. Sci. Technol.*, 39(9), 3289–3294, 2005.

DWESD

1, 71–86, 2008

## Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Hoefel, D., Grooby, W. L., Monis, P. T., Andrews, S., and Saint, C. P.: Enumeration of waterborne bacteria using viability assays and flow cytometry: a comparison to culture-based techniques, *J. Microbiol. Meth.*, 55, 585–97, 2003.

HyV: Hygieneverordnung (Hygiene regulation) des EDI (Eidgenössische Departement des Innern), Anhang 2, 2005.

Lebaron, P., Servais, P., Agogue, H., Courties, C., and Joux, F.: Does the high nucleic acid content of individual bacterial cells allow us to discriminate between active cells and inactive cells in aquatic systems?, *Appl. Environ. Microb.*, 67(4), 1775–1782, 2001.

Pepper, I. L., Rusin, P., Quintanar, D. R., Haney, C., Josephson, K. L., and Gerba, C. P.: Tracking the concentration of heterotrophic plate count bacteria from the source to the consumer's tap, *Int. J. Food Microbiol.*, 92(3), 289–295, 2004.

Reasoner, D. J. and Geldreich, E. E.: A new medium for the enumeration and subculture of bacteria from potable water, *Appl. Environ. Microb.*, 49(1), 1–7, 1985.

Rinta-Kanto, J. M., Lehtola, M. J., Vartiainen, T., and Martikainen, P. J.: Rapid enumeration of virus-like particles in drinking water samples using SYBR green I-staining, *Water Res.*, 38, 2614–2618, 2004.

Sartory, D. P.: Heterotrophic plate count monitoring of treated drinking water in the UK: a useful operational tool, *Int. J. Food Microbiol.*, 92, 297–306, 2004.

SLMB: Schweizer Lebensmittelbuch (Swiss book of food regulation), 56, E.1., 2000.

van der Kooij, D.: Managing regrowth in drinking-water distribution systems, in: *Heterotrophic plate counts and drinking-water safety*, edited by: Bartram, J., Cotruvo, J., Exner, M., Fricker, C., and Glasmacher, M., London, UK, World Health Organization (WHO) by IWA Publishing, 199–232, 2003.

Velten, S., Hammes, F., Boller, M., and Egli, T.: Rapid and direct estimation of active biomass on granular activated carbon through adenosine tri-phosphate (ATP) determination, *Water Res.*, 41, 1973–1983, 2007.

WHO: World Health Organization, *Guidelines for Drinking-water Quality (electronic resource): incorporating first addendum*, Vol. 1, Recommendations, 3rd Ed., 2006.

## Correlations between methods to assess microbial water quality

E. Siebel et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

## Correlations between methods to assess microbial water quality

E. Siebel et al.

**Table 1.** Linear regression analysis of different measurement parameters.  $R^2$ -values were calculated from different buildings, on different days and all data summarized ( $n=200$ ).

	TCC vs. ATP	TCC vs. HPC	HPC vs. ATP	HNA vs. ATP
Building 1	0.71	0.25	0.31	0.76
Building 2	0.63	0.45	0.29	0.56
Wednesday	0.66	0.34	0.17	0.63
Sunday	0.63	0.44	0.29	0.60
All data	0.69	0.36	0.31	0.67

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)


[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Correlations between methods to assess microbial water quality

E. Siebel et al.

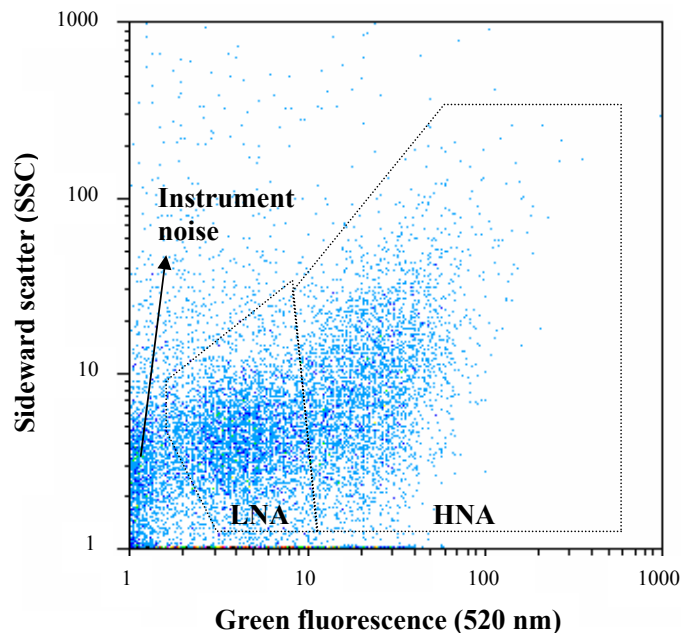

**Fig. 1.** A 2-dimensional flow cytometry dot-plot of green fluorescence (520 nm) and sideward scattered light (SSC), distinguishing so-called high nucleic acid (HNA) and low nucleic acid (LNA) content bacteria.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)


[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Correlations between methods to assess microbial water quality

E. Siebel et al.

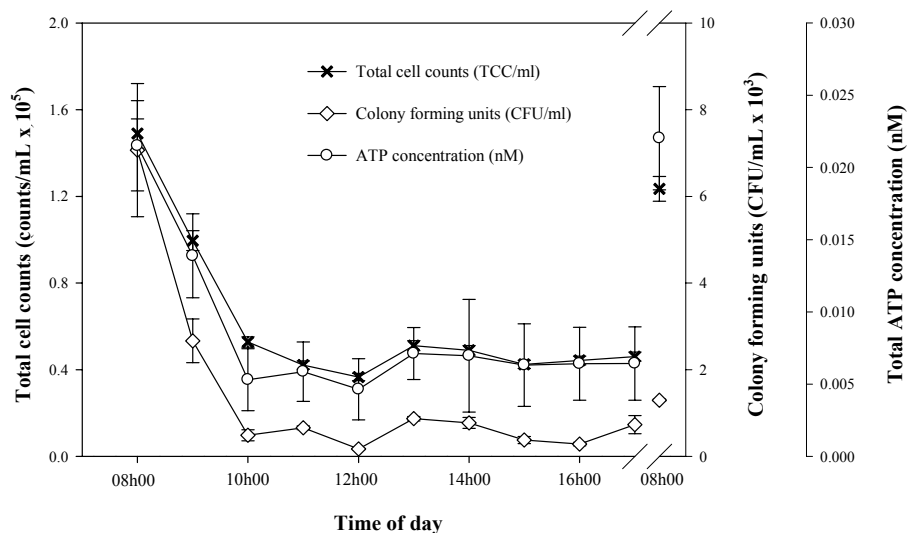

**Fig. 2.** Daily changes of total cell counts (TCC), colony forming units (CFU) and total adenosine tri-phosphate (ATP) concentration for one representative drinking water tap, sampled on a normal working day. Error bars indicate the standard deviation on triplicate measurements.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close


Full Screen / Esc

Printer-friendly Version

Interactive Discussion

Correlations between methods to assess microbial water quality

E. Siebel et al.

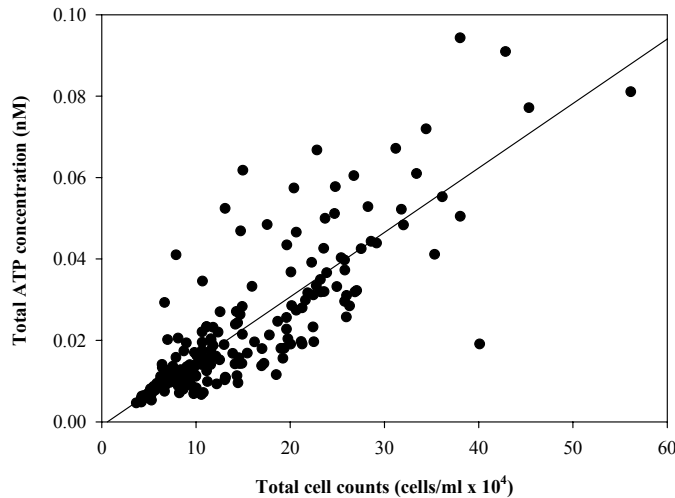

**Fig. 3.** Correlation between total ATP concentrations and total cell concentrations of all samples ( $n=200$ ). All data points represent average values of triplicate measurements.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

⏪

⏩

◀

▶

[Back](#)

[Close](#)


[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

**Correlations between  
methods to assess  
microbial water  
quality**

E. Siebel et al.

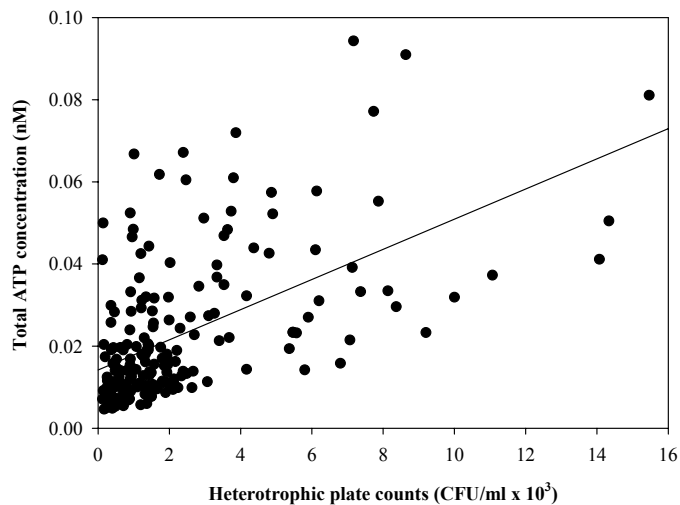

**Fig. 4.** Correlation between total ATP concentrations heterotrophic plate counts (HPC) of all samples ( $n=200$ ). All data points represent average values of triplicate measurements.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[⏪](#)[⏩](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)