

This discussion paper is/has been under review for the journal Drinking Water Engineering and Science (DWES). Please refer to the corresponding final paper in DWES if available.

# Accumulation and modeling of particles in drinking water pipe fittings

**K. Neilands, M. Bernats, and J. Rubulis**

Riga Technical University, Department of Water Engineering and Technology, Riga, Latvia

Received: 16 February 2012 – Accepted: 23 February 2012 – Published: 11 April 2012

Correspondence to: K. Neilands (kaspars.neilands@rtu.lv)

Published by Copernicus Publications on behalf of the Delft University of Technology.

**DWESD**

5, 139–171, 2012

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



## Abstract

The effect of pipe fittings – mainly T-pieces – on particle accumulation in drinking water distribution networks is shown in this work. The online measurements of flow and turbidity for cast iron, polyethylene and polyvinylchloride pipe sections have been linked with the analysis of pipe geometry. Up to 0.29 kg of the total mass of particles was found to be accumulated in T-pieces ranging from DN 100/100–DN 250/250. The accumulated amount of particles in the fittings was defined as  $J$  and introduced into the existing turbidity model PODDS (Prediction of Discolouration in Distribution Systems) proposed by Boxall et al. (2001), which describes the erosion of particles leading to discoloration events in drinking water networks, viz. sections, of straight pipes. It does not interpret the mobilization of particles in pipe fittings, however, which have been considered in this article. T-pieces were the object of this study and depending on the diameter or daily flow velocity, the coefficient  $J$  varied from 1.16 to 8.02.

## 1 Introduction

The accumulation of particles in drinking water distribution networks is commonly observed. A considerable number of studies have been done on explaining the fundamentals of processes (van Thienen et al., 2011a; Boxall et al., 2003). A mathematical description (Ryan et al., 2008; Boxall et al., 2001) and management advice (Vreeburg et al., 2004; Matsui et al., 2007; Saldarriaga et al., 2010; Husband et al., 2010) regarding water discoloration in a water supply network has been achieved.

A detailed work (Rayan et al., 2008) was carried out in order to explain the mechanisms responsible for particle accumulation in drinking water networks. However, in the proposed Particle Sediment Model (PSM), only the mechanism of gravitational force of particles where the threshold value for deposition is set as  $0.07 \text{ m s}^{-1}$  ( $ud$ ) and for resuspension  $0.2 \text{ m s}^{-1}$  (in 100 mm pipe) was included. As a second mechanism, the deposition of particles on the pipe walls was described (Ryan et al., 2008), which could affect the deposition by the van der Waals forces which are known as weak; in this

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



---

**Accumulation and modeling of particles in drinking water pipe fittings**

---

K. Neilands et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

case the small distance between the particles and pipe surface is important. Fick's law was used to describe the diffusion of particles from bulk flow to pipe wall. Although this mechanism was not included in the model, from the experimental results it was apparent that the particles (specific gravity 1.64) precipitated better on polyvinylchloride (PVC) than on a cement lined metal pipe. The concentration of particles on the PVC pipe wall is more sensitive to flow velocity, which does not include the region of gravitational settling ( $0.07\text{--}0.3\text{ m s}^{-1}$ ) (Ryan et al., 2008). The amount of particles deposited on the wall of the PVC pipes was shown to be larger than the amount deposited on the wall of the cement lined metal pipes, for the same working conditions (velocity, initial concentration). Although the lab-scale experiments were done in pipe loop (length = 41 m) consisting of four  $90^\circ$  bends, there was no information on any influence of loop geometry in the accumulation results (Ryan et al., 2008).

The application of the stochastic water demand model SIDMEUM (SIMulation of Demand, an End-Use Model) together with turbidity measurements from a uni-directional flushing (UDF) program showed that maximum daily velocities in range of  $0.05\text{--}0.1\text{ m s}^{-1}$  give the highest concentrations of particles in a network (Blokker et al., 2010). While it has been concluded that maximum daily velocity is not the only parameter responsible for particle accumulation, the role of radial transport processes can be explained by e.g. turbophoresis and turbulent diffusion, which was based on the laboratory-scale experiments (van Thienen et al., 2011) in which the deposition of particles on the entire wall circumference at velocity  $0.14\text{ m s}^{-1}$  with particles of specific gravity 1.2 was demonstrated. To describe these processes, the virtual mass effect which refers to inertia of particles in water together with the Magnus and the Saffman forces which describe the rotation of a particle in water was discussed regarding the particle accumulation process in pipe sections. The authors have not taken a closer look at the geometry; it can be remarked that the internal irregularities in the distribution pipe system may be catchment areas for particles. It should be noted that particles from wash-out during first flushing turnover can be called locally settled sediments (LSS) (Blokker et al., 2010).

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



Boxall et al. (2001) proposed the PODDS (Prediction of Discolouration in Distribution Systems) model by involving the term Cohesive Theory, where both the accumulation and the erosion of particles have been combined. Proposed empirical equations for the description of erosion have been verified in a lab-scale polyethylene (PE) pipe loop (length = 600 m) with an elliptical form Husband and Boxall (2008), and in both plastic and roughly corroded metal pipes with different diameters in field conditions (Husband and Boxall, 2010). The shear stress and subsequent erosion of particles increased with the flow. It is considered that the accumulation of particles occurs in layers around the complete pipe circumference which is conditioned via the daily hydraulic flow. The accumulation mechanisms via corrosion (direct) and background concentration of material from upstream or treatment plant (indirect) have been discussed (Husband and Boxall, 2010). The origin of the particles in distribution networks has been widely described (Gauthier et al., 1999; Verberk et al., 2006; Husband and Boxall 2008; Vreeburg et al., 2007). This is not the subject of the current paper. There is some criticism expressed towards the PODDS model, e.g. that (1) the formulations of the equations which predict the accumulation rate of particles should be subordinated to the fundamental laws (van Thienen et al., 2011) and (2) the parameter that the rate of change of the velocity or, subsequently, unsteady shear stress is applied during the early stage of the hydraulic transient event (e.g. fast valve opening/closing) plays a significant role for the first seconds of erosion of the particles (Aisopou et al., 2010). It should be mentioned that PODDS supports the cohesive layer assumptions in the approach considering the entire pipe length irrespective of the topographical features, while afterwards, some irregularities in washed out particle concentration obtained during trunk main flushing within section consisting of four 90° bends and depressions in the pipe topography have been noted (Husband et al., 2010).

The particle accumulation and the subsequent erosion within the drinking water pipe networks has been broadly described within the past few years. However, there is a lack of information regarding the particle concentration in locations where water flow changes due to geometry of conventional fittings (T-bends, valves, bends etc.). In a

recent study, we reported the analysis of detailed pipe geometry (topology) and online turbidity curves obtained from particle erosion during UDF via one and two hydrants simultaneously and demonstrated that these pikes fitted to the location of network fittings (Rubulis and Neilands, 2010).

5 In this work, the influence of pipe geometry in the accumulation process of particles in drinking water distribution networks has been investigated. The major objectives of this study were to: (1) analyze UDF data from field events with different diameter T-pieces and other fittings; (2) link UDF data (velocity, turbidity and mass) with equations of PODDS in an online measurement timesheet to model the erosion of particles;  
10 (3) explain the field measurements using an approach from tracer studies regarding particle transport in other industrial applications.

## 2 Materials and methods

### 2.1 Description of study site

The UDF operation was performed in a town with population of about 9000 inhabitants. The overall network consists of 13 km of cast iron (CI) material, of 4 km PVC and of  
15 3 km of polyethylene (PE) pipes (Fig. 1).

The CI pipes were mainly constructed between the years 1970 and 1990 while the PVC and PE pipes were built during the years 2000 and 2011. For the supply of the drinking water network, the treatment with oxidation using air  $700 \text{ m}^3 \text{ day}^{-1}$  has been  
20 applied. The water quality in the outlet of the plant from the grab sample program summarized in Table 1 is characteristic of corrosive water with a high salt concentration. Neilands et al. (2009) proved that the application of the online monitoring system reveals the problems with the particle load in the network due to a deficient operation of rapid sand filters during the flushing process in the morning hours (Fig. 2).

25 The network had not been flushed before. The accumulation of sediments in the network was assessed with the resuspension potential method (RPM) proposed by Vreeburg et al. (2004) which revealed considerable risk of discoloration (Table 2).

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



## 2.2 Experimental design of field measurements

In general, the online turbidity data from UDF were linked with a careful analysis of technical drawings of each flushed pipe section while paying particular attention to the location of fitting. In total, 67 isolated pipe sections were flushed. The turbidity data during the flushing process were recorded for at least every minute (in several cases even 5 s) using calibrated online photometer ULTRATURB plus<sup>TM</sup> equipped with a controller sc 100<sup>TM</sup> (Dr. Bruno Lange GmbH&Co, Düsseldorf, Germany) installed into a flushing vehicle equipped with a manometer and an online flow meter Siemens Sitrans FM MAG 8000 (Siemens Energy & Automation Inc., Germany). The standard deviation for measurements was  $\pm 30$  s, depending on how fast the necessary flow rate was reached during the opening of the fire hydrant. Mechanical cleaning of the measuring chamber in addition to the automatic cleaning of the measuring chamber of ULTRATURB plus<sup>TM</sup> was routinely performed.

The clear PVC pipe segment (inner  $\varnothing$  75 mm) in the flushing vehicle was connected with a 1 m long fire hose (inner  $\varnothing$  75 mm), which was connected directly to the standpipe of the hydrant. The construction of the flushing vehicle was done assuming that the water flow from the standpipe would have the shortest possible path to the online turbidity meter. The online turbidity measurements during UDF were controlled with simultaneous turbidity measurements in grab samples performed with a portable manual turbidity meter Hach 2100P (Dr. Bruno Lange GmbH&Co, Düsseldorf, Germany). This was done in a synchronized manner with all the measuring equipment at the start of the flushing.

## 2.3 Hydraulic model

The pipe hydraulic model (1073 pipes and 986 nodes) was built up using the EPANET 2.0 system (Rossman, 2000) and the hydraulic head loss was calculated with the Darcy-Weisbach equation and a top-down demand approach. The time step for

DWESD

5, 139–171, 2012

### Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



hydraulic head loss calculation was set to 1 s. The node demands were collected from 6 month data survey for every connection. The daily pattern of consumption for inhabitants was set to  $630 \text{ m}^3 \text{ day}^{-1}$ . The daily patterns for companies and municipal organizations were set according to the information from the municipality of the registered drinking water consumption. There were two organizations in the municipality working constantly day and night, but the total amount of water consumption was only about  $0.5 \text{ m}^3 \text{ h}^{-1}$ ; thus, they did not influence the data generated by the model. The verification of water residence time was conducted by tracer studies (Fig. 3) since each well in the water treatment plant had different electric conductivity (EC) in the range of  $500\text{--}900 \mu\text{S cm}^{-1}$  ( $25^\circ\text{C}$ ).

All field measurements were recorded for several hours and were made from hydrants or at the taps in the buildings belonging to the drinking water supplier. For the field measurements, online instruments 3400sc<sup>TM</sup> with controller sc 100<sup>TM</sup> (Dr. Bruno Lange GmbH&Co, Düsseldorf, Germany) and conductivity<sup>TM</sup> with controller conductivity<sup>TM</sup> (Scan Meßtechnik GmbH, Vienna, Austria) supplemented with portable manual EC meter Cond 315i, (WTW, Germany) were used. The results of model verification are not shown in this study.

## 2.4 Analysis of turbidity curves

In order to generalize the trends of particle erosion observed during field experiments/UDF, the following assumptions were made:

1. The hydraulic circumstances of the particle disturbance were based on the assumption that the accumulated particles erode and are transported by a plug flow. The distance ( $L$ , m) from hydrant outlet to where the erosion of particles starts was calculated with the formula below:

$$L = \frac{t \cdot \pi \left(\frac{D}{2}\right)^2}{Q} \quad (1)$$

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



**Accumulation and modeling of particles in drinking water pipe fittings**

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



where  $t$  is time (s),  $Q$  – flow rate ( $\text{m}^3 \text{s}^{-1}$ ) and  $D$  – diameter of pipe (m). The same assumption has been used previously and, in addition, the term “locally settled sediment” (LSS) has been introduced (Blokker et al., 2010).

2. By using the principle of back-tracing, the location in the pipe where the particles had originated from the maximum values (30 NTU and 26 NTU) from turbidity curves for a certain section of flushed pipe were allocated in this study (Fig. 4).
3. The maximum value (30 NTU and 26 NTU) of each pipe was divided with the average value (17 NTU of turbidity from beginning):  $\text{Turb}_{\text{max}}/\text{Turb}_{\text{average}} = J$  coefficient. This value was used for the calculation of next peak magnitude, in case the upflow had some other fittings. Hence, a comparison of the difference between the particles originating from a linear pipe section and the particles which accumulated in the fittings could be compared.

The is a large number of data from flushing studies needed to calculate a fitting coefficient for various conditions in order to predict the fouling of pipes with particles at the locations of T-pieces and valves.

## 2.5 Modeling particle erosion in drinking water network including fittings

The strength of layers in PODDS is based on the hydraulic shear stress (Boxall et al., 2001). The maximum shear stress, according to this hydraulic model, is responsible for the layer strength and the amount of fouling material that has eroded during a hydraulic event in a straight pipe section. It means that according to a validated hydraulic model in the conditions of the maximum consumption of water per day, the maximal shear stress to pipe walls is calculated as follows:

$$\tau = \rho g \frac{D}{4} \Delta H \tag{2}$$

where  $\tau$  is boundary shear stress ( $\text{N m}^{-2} \text{m}^{-1}$ ),  $\rho$  – density of water ( $\text{kg m}^{-3}$ ),  $g$  – gravity acceleration ( $\text{m s}^{-2}$ ),  $D$  – diameter of pipe (m),  $\Delta H$  is the head loss due to



friction (mH<sub>2</sub>O).

To calculate  $\Delta H$ , the Darcy-Weisbach equation was used:

$$\Delta H = f \frac{LV^2}{D2g}$$

where  $L$  – the length of the pipe (m);  $V$  – the average velocity of the fluid flow, equal to the volumetric flow rate per unit cross-sectional wetted area (m s<sup>-1</sup>);  $f$  – a dimensionless coefficient (Darcy friction factor).

The turbidity curve predictions were calculated in a created algorithm (MS Excel). Using the PODDS model and substituting the equations therein, the output turbidity is equal to:

$$\Delta C_c(t = 1) = R_{\text{link}} \quad (3a)$$

$$\Delta C_c(t \geq 2) = \underbrace{\Delta C_c(t = 1)}_{\text{turbidity value at previous time}} \times \underbrace{\left(1 - \frac{R_{\text{link}} \times \Delta t \times n}{C_{\text{max}}}\right)}_{\text{Decrease term}} \quad (3b)$$

where  $\Delta C$  is the turbidity value at the current time at the flushing outlet. At time  $t = 1$ , turbidity will have the maximum possible peak value for the corresponding layer strength followed by gradual decrease of maximal peak value at  $t \geq 2$  and so on. Character  $\Delta t$  is the value of the time step in seconds,  $n$  is the number of the current time step,  $R_{\text{link}}$  is the output peak turbidity for the corresponding link,  $\text{Turb}_{\text{total}}$  is the total accumulated mass following a flushing event.

To predict the erosion of particles and obtain the character of the turbidity curve, the following equation was used:

$$\Delta N = R \times A_s \quad (4)$$

**Accumulation and modeling of particles in drinking water pipe fittings**

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



where  $\Delta N$  is the increase or decrease of turbidity (NTU),  $R$  is the rate of supply (NTU m<sup>-2</sup>),  $A_s$  is the pipe surface area (m<sup>2</sup>).

Turbidity peak for plug flow will occur at some (current) time  $C$ , after which it will gradually decrease, described by turbidity decrease term. The maximum peak value was calculated from the difference of the standard maximum velocities (hourly and flushing), in terms of corresponding shear stresses, regardless to the mass accumulated in pipe. The total accumulated mass was used to calculate the total turbidity mass via linear daily shear stress – turbidity relationship, (NTU m<sup>3</sup>) = -475 000 $\tau_{\text{daily}}$  + 529 000. Because of the total turbidity dimensions, the obtained value should be multiplied by the number of cubic meters in the pipe to obtain the total link turbidity and its maximal peak value. The magnitude of decrease depends on the coefficient used:  $P$  and exponent:  $n$  (variables in our case  $P = 0.1$  and  $n = 0.5$ ) in the rate of supply from the layer calculations:

$$R = P(\tau_{\text{flush}} - \tau_{\text{daily}})^n \quad (5)$$

The layers can have higher stored turbidity volume with a decrease in the layer strength (Boxall et al., 2001). This means that pipes with a low flow rate have a higher potential of turbidity accumulation and the same factor is referable to the fittings. By generalizing PODDS model, it can be said that in the conditions of constant flow and constant shear stress, the output turbidity will have only one peak, without considering the local turbulences in the fittings. As it was observed from the case study, after the first turbidity peak a second or third peak may follow, which often are higher than the first one. It was calculated that time of all the next peaks mainly conforms to the time it takes the plug flow to travel from the fitting of a downstream pipe. Thus in this study, we have applied an additional term to the aforementioned turbidity equation in order to account for all peaks, representing the downstream fittings.

$$\text{Turbidity}(t \geq 2) = \text{Turb}_{\text{max}}(t=1) \times \left(1 - \frac{R \times t}{\text{Turb}_{\text{total}}}\right) + \underbrace{\text{Turb}_{\text{average}} \times J \left(1 - \frac{R \times t}{(Q \times t \times \text{Turb} \times \text{TSS} \times 10^{-6})}\right)}_{\text{Additional term describing the impact of a fitting}} \quad (6)$$

Additional term describing the impact of a fitting

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



where

$$\text{Turb}(t = 1) = R \times A_s$$

$$\text{Turb}_{\text{total}} = C_{\text{max}} / (\pi r^2 L)$$

$$\text{Turb}_{\text{average}} = \text{Turb}_{\text{total}} / t$$

$t$  is time (in seconds),  $R$  – rate of supply ( $\text{NTU m}^{-2}$ ),  $A_s$  – pipe surface area ( $\text{m}^2$ ),  $r$  – radius of pipe (m),  $J$  – coefficient of a fitting,  $L$  – length of pipe,  $\text{NTU}_{\text{average}}$  denotes average output turbidity in first peak,  $C$  – the stored turbidity, calculated from layer shear strength  $\tau$  ( $\text{NTU m}^3$ ) calculated with Eq. (2).

## 2.6 Calculations of particle mass

The mass (kg) of particles in a fitting was calculated using the following equation:

$$M = \Sigma(Q \times t \times \text{Turb} \times \text{TSS} / 10^6) \quad (7)$$

where  $t$  is time (in seconds),  $Q$  – flow rate ( $\text{l s}^{-1}$ ),  $\text{Turb}$  – the turbidity data from the online photometer (NTU),  $\text{TSS} = 77.3 \text{ mg l}^{-1}$ . The total of the suspended solids was assumed as a constant for all the calculations (Boxall et al., 2003) where a wide range of samples obtained from different drinking water networks were analyzed.

In Eq. (7) all the turbidity online measurements were summed up and each of the NTU readings was converted to mass, using the above mentioned TSS constant, allowing the total mass of the flushing event to be calculated. It was assumed that the flushing plug flow velocity was equal to the flow velocity. Thus by logging online discharge data, the time from start of the flushing event and knowing the diameters of the pipes located downstream the flow velocity and thus passed distances downstream the pipe being flushed were calculated. As reported earlier, close similarities between online turbidity measurements peaks and downstream fitting were detected (Rubulis and Neilands, 2010).

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



### 3 Results and discussion

#### 3.1 Field experiments

More than 67 isolated sections were flushed using UDF to collect turbidity data from washed-out particles. Both sections of CI, PVC, and PE pipes were examined. The pipe diameters ranged from 100 to 300 mm. The discharge from hydrant was maintained constant to ensure constant shear stress on particles thus the possible fluctuations in hydraulic conditions could take place only due to the changes in water production/consumption ratio. In Table 3, all data corresponding only to flushed sections with T-piece is summarized, since this type of fitting has most often been represented, instead of the bend of 30°, 60°, 90°, but those data points were too few to make any valid approximation trends.

The total mass of washed out particles from T-pieces in this study ranged from 0.05 to 0.29 kg. This mass was calculated taking into account the relationship between turbidity and total suspended solids from the studies of Boxall et al. (2003). The quantities of particles in our study was higher compared to the data from the literature. The mass of about 0.0001–0.04 g m<sup>-1</sup> was found to be present in four different Canadian networks (Carriere et al., 2005). The quantity of particles described by the other authors was even smaller 0.00008 g m<sup>-1</sup> (Jonas and Mupphy, 2002) and 0.026 g m<sup>-1</sup> (Delanoue et al., 1997). The conclusion in this study was that neither flushing (0.37–2.14 m s<sup>-1</sup>) nor daily maximum velocity (0.02–0.39 m s<sup>-1</sup>) correlated with the washout mass of the particles. It should be noted that a similar conclusion about flushing velocity (0.65–2.3 m s<sup>-1</sup>) and the washed out mass of particles has previously been observed (Carriere et al., 2005). Analyses of the impact of daily maximum velocity on the washed out mass of particles would normally have been done applying a careful hydraulic analysis using a “bottom-up” demand allocation principle, e.g. SIDMEUM (Blokker et al., 2008), rather than the “top-down” approach used in this study.

In previous studies, the concentration of particles (or water turbidity) in distribution networks were studied depending on (1) source water quality and treatment process.

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Unfiltered systems have the greatest mass of solids compared to those applying filtration, with the mass decreasing based on source water and level of treatment (Ryan et al., 2008; Vreeburg et al., 2008) (2) the distance in the network, namely the increase of the particle concentration towards the mains dead ends (Gauthier et al., 2001; Matsui et al., 2007); (3) the topography which is indirectly confirmed by the number of customer complaints about water quality in undulating terrains compared to those in flat terrains (Polychronopolous et al., 2003), (4) diameter of pipes where increased particle concentration in trunk mains which in the network acts as sedimentation tanks has been previously shown (Husband et al., 2010; Saldarriaga et al., 2010). (5) An incontrovertible factor which affects the concentration of particles is the maximum daily velocity which can be related with particles by applying “bottom-up” demand modeling has been described earlier (Blokker et al., 2008). The same opinion is postulated in the cohesive transport modeling approach called PODDS (Boxall et al., 2001; Boxall and Saul, 2005; Husband and Boxall, 2010), which predicts that the particles on pipe walls are conditioned by the shear stress of daily hydraulics.

By applying the principle of back-tracing the eroded particles and by analyzing the turbidity and flow data from the UDF online measurements which were then linked with pipe geometry, it was concluded that most of the particles were located within the pipe fittings.

This conclusion is not fully consistent with the approach postulated in the PODDS since it may indicate that the particles will not accumulate in an annular manner. In this study, the asymmetrical accumulation of particles within the fittings was found, which is consistent with the scientific studies performed in other areas of research (Fokker et al., 2003). The flow structure, and specifically vortex pairs, formed downstream of the 90° bend has been investigated in both a micro-channel system e.g. 0.209 mm (Xiong and Chung, 2008) and pipe systems with diameters typical for drinking water mains, e.g. 150 mm (Peters and Ruppel, 2004). It should be noted that in both cases, the velocity was significantly higher than that found in drinking water networks, respectively 0.55–8.23 m s<sup>-1</sup> (Xiong and Chung, 2008) and 8.3–31.1 m s<sup>-1</sup> (Peters and

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



Ruppel, 2004) and in both cases a fully developed vortex formed while circular motion (outer/inner wall vortex after fittings) started to develop already at lower velocities which corresponds to the conditions in drinking water systems. Some tracer studies have reported an incomplete mixing at the pipe fittings (e.g. cross and double T-piece) in water flow and simulations with computational fluid dynamic (CFD) models at velocities (0.35–1.4 m s<sup>-1</sup>) have shown flow trajectories and possible vortex zones suitable for accumulation of particles after fittings (Ho et al., 2006; Webb and van Bloemen Waanders, 2006). Guided by the concept of particle rotational trajectories in drinking water networks generated by inertia, the Magnus and the Saffman forces (van Thienen et al., 2011), the development of radial processes in fittings instead of gravitational settling can be expected.

To generalize the observations from field experiments and to compare results of the erosion of accumulated particles in different T-pieces, the relationship between the maximum and average turbidity value from each specific section was calculated ( $J$  coefficient), which characterized the potential of the accumulated particles. The hydraulic conditions in specific T-piece were expressed in the relationship  $V/D$  (maximal velocity per hour in typical day and diameter of inlet section of T-piece) as non-dimensional parameter.

With the increase of the maximum velocity per hour in the same fitting, the accumulated concentration of particles will decrease (Fig. 5). This relationship obtained from field experiments will supplement the knowledge presented in the PODDS model (Boxall et al., 2001).

$V/D$  reaches “self-cleaning” proportions, which are approximately 0.35 m s<sup>-1</sup> (Blokker et al., 2010); theoretically, after that  $J$  continues in a linear line with a value of 1. The same function can be obtained for other types of fittings.

### 3.2 Modeling particle erosion

In order to model particle erosion from field experiments where network sections with T-pieces were flushed, an algorithm was added to the PODDS and the modeling results

were compared with the original PODDS parameters. This improved modeling approach allows us to divide the modeled straight pipe sections in segments between the fittings and application of the coefficient for the potential particle accumulation ( $J$ ) in every step. The first site presented here had a typical straight section of Cl transport main with a nominal diameter 200 mm and two T-pieces for connections (Fig. 6). The location of this site is shown in Fig. 1 and other parameters which describe this site are shown in Table 3 as Case Study No. 1.

Figure 7 shows the temporal turbidity response within flushing, reaching two peaks 110 and 68 NTU. Measured particle erosion was compared with the simulations of PODDS, which replicates only the rise and exponential decay of first peak of turbidity within the first 200 s of flushing. Introducing the coefficient  $J$  into PODDS and dividing the simulated section in two segments allowed us to gain two peaks which approximately repeats measured data.

The second flushing site was chosen since it had two 90° bends which are infrequently found in drinking water systems, unlike T-pieces (Fig. 8). The flushed section was 718 m long and consisted of sections of 200 and 300 mm. The velocity obtained during flushing reached 0.57 and 0.87 m s<sup>-1</sup>, respectively.

The online turbidity results are shown in Fig. 9. which shows two visible turbidity peaks. The simulation results with PODDS and with PODDS supplemented with the coefficient  $J$  are also shown here. Both simulation results only partially follow the magnitude of the first peak and display a much steeper decrease in turbidity compared to the measured values. The upgraded model, having the coefficient  $J$ , is in better agreement with the online data compared to the original PODDS. The repeatability of accumulation of particles in fittings was proved with UDF in one Cl pipe section of 1358 m length with 200/300 mm diameter two times within a 5-month period showing the same pattern of turbidity (Rubulis and Neilands, 2010).

Due to the copyright law, the authors of the PODDS do not present the values of model parameters ( $k$ ,  $b$ ,  $P$  and  $n$ ). Thus, in this study these were estimated using a trial and error approach. Some authors have attempted to replicate the erosion of

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



particles using the PODDS approach and have used the following parameter values  $C_{\max} = 10$ ,  $k = -0.15$ ,  $b = 1$ ,  $P = 0.0000065$  and  $n = 2.5$  (Asopou et al., 2010) and  $C_{\max} = 5.0$ ,  $k = -1.5$ ,  $b = -2.5$ ,  $P = 0.0065$ ,  $n = -3.5$  (Naser, 2006). By using the parameter values from Asopou et al. (2010) and Naser (2006) in our case studies, the modeled results differed significantly. These results indicate that the parameters are site specific and therefore cannot be generalized.

Various aspects need to be improved in the prediction and measurement of particle accumulation/erosion: the optical tomography presented by van Thienen et al. (2011b) can be one of the instruments; RPM could be updated based on the fitting quantity in a particular pipe section. Future work in this field should concentrate upon gaining a greater understanding of the development and formation of vortex or centrifugal forces in pipe fittings of drinking water distribution networks.

## 4 Conclusions

Measurements of turbidity, flow during UDF and analysis of pipe geometry showed the significance of the accumulation of particles in pipe fittings. The turbidity potential of accumulated particles ( $J$ ) was determined for T-pieces of several sizes of DN 100/100–DN 250/250 for CI and PE pipes. The existing turbidity model PODDS was updated with an additional term for pipe fittings – ( $J$ ). The total mass of particles accumulated in the T-pieces ranged from 0.05 to 0.29 kg.

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion





## Appendix A

### Notation

$J$	coefficient of a fitting/turbidity potential of accumulated particles
$\Delta C_c$	changes in turbidity potential ( $\text{NTU m}^2 \text{s}^{-1}$ )
$\tau$	boundary shear stress ( $\text{N m}^{-2} \text{m}^{-1}$ )
$\rho$	density of water ( $\text{kg m}^{-3}$ )
$g$	gravity acceleration ( $\text{m s}^{-2}$ )
$D$	diameter of pipe (m)
$\Delta H$	head loss due to friction ( $\text{mH}_2\text{O}$ )
$L$	length of the pipe (m)
$V$	average velocity of the fluid flow ( $\text{m s}^{-1}$ )
$f$	a dimensionless coefficient called the Darcy friction factor
$\Delta N$	in/decrease of turbidity (NTU)
$R$	rate of supply ( $\text{NTU m}^{-2}$ )
$A_s$	pipe surface area ( $\text{m}^2$ )
$t$	time (s)
$R$	rate of supply ( $\text{NTU m}^{-2}$ )
$r$	radius of pipe (m)
$C$	stored turbidity, calculated from layer shear strength
$M$	mass of particles (kg)
TSS	total suspended solids ( $\text{mg l}^{-1}$ )
$Q$	flow rate ( $\text{m}^3 \text{s}^{-1}$ or $\text{l s}^{-1}$ )
$D$	diameter of pipe (m)
$\pi$	a mathematical constant approx. equal to 3.14
$P$	gradient term (NTU/N)
$n$	power term (–)

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



*Acknowledgements.* This work has been supported by the European Social Fund within the project “Support for the implementation of doctoral studies at Riga Technical University”.

This work has been undertaken as a part of the research project “Technology enabled universal access to safe water – TECHNEAU” (Nr. 018320), which is supported by the European Union within the 6th Framework Programme.

A disclaimer follows, stating that the authors are solely responsible for this work. It does not represent the opinion of the Community and the Community is not responsible for any use that might be made of data appearing herein.

The authors are thankful to Sandis Dejus for assistance in the calibration of the hydraulic model and the director of Adazi udens Ltd., Janis Neilands, for his advice and guidance during the field campaign. Special thanks must be expressed to Edgars Grundbergs and Janis Neilands Jr. for assistance with the flushing and tracer campaigns. Special thanks are due to Talis Juhna and Simona Larsson.

## References

- Aisopou, A., Stoianov, I., and Graham, N.: Modelling Discoloration in WDS Caused by Hydraulic Transient Events, in: Proceedings of the Water Distribution System Analysis Conference. Tucson, Arizona. – ASCE Conf. Proc., doi:10.1061/41203(425)49, 2010.
- Blokker, E., Vreeburg, J., Schaap, P., and van Dijk, J.: The self-cleaning velocity in practice, in: Proceedings of the Water Distribution System Analysis Conference. Tucson, Arizona, ASCE Conf. Proc., doi:10.1061/41203(425)19, 2010.
- Blokker, E. J. M., Vreeburg, J. H. G., Buchberger, S. G., and van Dijk, J. C.: Importance of demand modelling in network water quality models: a review, *Drink. Water Eng. Sci.*, 1, 27–38, doi:10.5194/dwes-1-27-2008, 2008.
- Boxall, J. B. and Saul, A. J.: Modeling discoloration in potable water distribution systems, *J. Environ. Eng.*, 131, 716–725, 2005.
- Boxall, J. B., Skipworth, P. J., and Saul, A. J.: A novel approach to describing sediment movement in distribution mains, based on measured particle characteristics, *Water Softw. Syst.*, 1, 263–273, 2001.
- Boxall, J. B., Saul, A. J., Gunstead, J. D., and Dewis, N.: Regeneration of discoloration in

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)



[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

distribution systems, World Water and Environmental Resources Congress, Philadelphia, 434–442, 2003.

Carriere, A., Gauthier, V., Desjardins, R., and Barbeau, B.: Evaluation of Loose Deposits in Distribution Systems through Unidirectional Flushing, *Journal American Water Works Association*, 97, 82–92, 2005.

Delanoue, A., Holt, D. M., Woodward, C. A., McMath, S. M., and Smith, S. E.: Effect of Pipe Materials in Biofilm Growth and Deposition Formation in Water Distribution Systems, in: *Proc. Of the Water Quality Technology Conference*, Denver, 9–12 November 1997, Denver, Colo.: AWWA, 1997.

Fokker, S., Kingman, S., Lowandes, I., and Reynolds, A.: Characterisation of the cross sectional particles concentration distribution in horizontal dilute flow conveying – a review, *Chem. Eng. Process.*, 43, 677–691, 2003.

Gauthier, V., Gerard, B., Portal, J.-M., Block, J.-C., and Gatel, D.: Organic matter as loose deposits in a drinking water distribution system, *Water Res.*, 33, 1014–1026, 1999.

Gauthier, V., Barbeau, B., Millette, R., Block, J.-C., and Prévost, M.: Suspended particles in the drinking water of two distribution systems, *Wa. Sci. Technol.*, 1, 237–245, 2001.

Ho, C. K., Orear Jr., L., Wright, J. L., and McKenna, S. A.: Contaminant Mixing at Pipe Joints: Comparison between Laboratory Flow Experiments and Computational Fluid Dynamics Models, in: *Proceedings of the Water Distribution System Analysis Symposium*. Cincinnati, Ohio – ASCE Conf. Proc., doi:10.1061/40941(247)153, 2006.

Husband, S. and Boxall, J. B.: Field studies of discoloration in water distribution systems: model verification and practical implications, *J. Environ. Eng.*, 36, 86–94, 2010.

Husband, S., Williams, R., and Boxall, J. B.: Discolouration risk management for trunk mains, in: *Proceedings of the Water Distribution System Analysis Conference*. Tucson, Arizona – ASCE Conf. Proc., doi:10.1061/41203(425)50, 2010.

Husband, P. S., Boxall, J. B., and Saul, A. J.: Laboratory studies investigating the processes leading to discoloration in water distribution networks, *Water Res.*, 42, 4309–4318, 2008.

Jonas, S. and Murphy, B.: Distribution System Flushing Optimization to Reduce Environment Impact, *Proc. AWWA WQTC*, Seattle, 2002.

Matsui, Y., Yamagishi, T., Terada, Y., Matsushita, T., and Inoue, T.: Suspended particles and their characteristics in water mains: development of sampling methods, *J. Water Supply Res. T.*, 56, 13–24, 2007.

Naser, G.: Water quality transformations in pipelines: a two-dimensional multi-component

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



simulation model, Doctor of Philosophy, Civil Engineering, University of Toronto, Toronto, 2006.

Neilands, K., Rubulis, J., and Juhna, T.: Application of Online Monitoring, Resuspension Potential Method and Unidirectional Flushing for Control of Drinking Water Quality in a Distribution Networks, Latvia, in: Proceedings 1st Eastern European Regional Young Water Professionals Conference, Minsk, Belarus, ISBN 987-985-525-145-4, 2009.

Peters, F. and Ruppel, C.: A pressure probe for the detection of the flow direction close to walls. Case study: flow through a bend, *Exp. Fluids*, 36, 813–818, 2004.

Polychronopolous, M., Dudley, K., Ryan, G., and Hearn, J.: Investigation of factors contributing to dirty water events in reticulation systems and evaluation of flushing methods to remove deposited particles., *Wa. Sci. Technol.*, 3, 295–306, 2003.

Rossmann, L. A.: EPANET 2 Users Manual, EPA/600/R-00/057, US Environmental Protection Agency, Cincinnati, OH, 2000.

Rubulis, J. and Neilands, K.: Interpretation of loose deposits motion in drinking water distribution network, in: Proceedings of the Water Distribution System Analysis Conference. Tucson, Arizona – ASCE Conf. Proc., doi:10.1061/41203(425)61, 2010.

Ryan, G., Mathes, M., Haylock, G., Jayaratne, A., Wu, J., Noui-Mehidi, N., Grainger, C., and Nguyen, B. V.: Particles in Water Distribution Systems, Tech. Rep. 33, Cooperative Research Centre for Water Quality and Treatment, 2008.

Saldarriaga, J., Nieto, L., Hernández, F., and Osorio, C.: Discolored Water Analysis and Modeling for Trunk Networks: The Case of Bogotá, Colombia, in: Proceedings of the Water Distribution System Analysis Conference. Tucson, Arizona – ASCE Conf. Proc., doi:10.1061/41203(425)48, 2010.

van Thienen, P., Floris, R., and Meijering, S.: Application of optical tomography in the study of discolouration in drinking water distribution systems, *Drink. Water Eng. Sci.*, 4, 61–69, doi:10.5194/dwes-4-61-2011, 2011a.

van Thienen, P., Vreeburg, J. H., and Blokker, E. J.: Radial transport processes as a precursor to particle deposition in drinking water distribution systems, *Water Res.*, 45, 1807–1817, 2011b.

Verberk, J. Q. J. C., Hamilton, L. A., O'Halloran, K. J., van der Horst, W., and Vreeburg, J.: Analysis of particle numbers, size and composition in drinking water transportation pipelines: results of online measurements, *Wa. Sci. Technol.*, 6, 35–43, 2006.

Vreeburg, J. H. G.: Discolouration in drinking water systems: a particular approach, Academic

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



dissertation, Delft University of Technology, Delft, p. 183, 2007.

Vreeburg, J. H. G., Schaap, P., and van Dijk, J. C.: Measuring Discoloration Risk: Resuspension Potential Method, IWA Leading Edge Conference, Prague, 2004.

Vreeburg, J. H. G., Schippers, D., Verberk, J. Q. J. C., and van Dijk, J. C.: Impact of particles on sediment accumulation in a drinking water distribution system, *Water Res.*, 42, 4233–4242, 2008.

Webb, S. W. and van Bloemen Waaders, B. G.: High fidelity computational fluid dynamics for mixing in water distribution systems, in: Proceedings of the Water Distribution System Analysis Symposium, Cincinnati – ASCE Conf. Proc., doi:10.1061/40941(247)154, 2006.

Xiong, R. and Chung, J.: Effects of miter bend on pressure drop and flow structure in micro-fluidic channels, *Int. J. Heat Mass Tran.*, 51, 2914–2924, 2008.

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

**Table 1.** The water quality in water works (treatment plant). The average results with standard deviations and coefficient of variation (in brackets) are shown.

Parameter, units	Average results
Conductivity, $\mu\text{S cm}^{-1}$	$739 \pm 16(20)$
pH	$6.97 \pm 0.38(18)$
Iron (Fe tot), $\text{mg l}^{-1}$	$0.05 \pm 0.02(4)$
Iron (FeII), $\text{mg l}^{-1}$	$0.01 \pm 0.01(4)$
Turbidity, NTU	$0.344 \pm 0.32(94)$
Chlorine (tot) $\text{mg l}^{-1}$	$0.038 \pm 0.033(17)$
Chlorine (free), $\text{mg l}^{-1}$	$0.012 \pm 0.021(8)$
Langelier Index	-1.23
Red-ox, mV	$204 \pm 10(17)$

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

**Table 2.** The results of RPM ranking measured with Ultraturb™ equipment in the field study place (Fig. 1).

Nr.	diameter, mm	material	section length, m	RPM	Average turbidity (NTU)
1	100	PVC	326	14	114.6
2	150	CI	326	14	36.0
3	150	CI	397	7	6.9
4	150	CI	423	5	3.8
5	150	CI	401	10	10.7
6	200	PE	324	15	105.8
7	100/200	PVC/CI	456	6	6.8

[Title Page](#)
[Abstract](#)
[Introduction](#)
[Conclusions](#)
[References](#)
[Tables](#)
[Figures](#)
[Back](#)
[Close](#)
[Full Screen / Esc](#)
[Printer-friendly Version](#)
[Interactive Discussion](#)


## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

**Table 3.** Description of T-pieces.

Case study	$V_{\text{day max}}$ ( $\text{m s}^{-1}$ )	$\tau_{\text{day max}}$ ( $\text{N m}^{-2}$ )	$V_{\text{flush}}$ ( $\text{m s}^{-1}$ )	$\tau_{\text{flush}}$ ( $\text{N m}^{-2}$ )	Fitting type (mm)	$J$ (–)	Mass in fitting (kg)	$V/D$ (–)	Pipe material	Pipe length (m)
1	0.21	0.15	0.43	0.59	T-piece DN200/100	1.87	0.24	1.05	Cast iron	457
2	0.24	0.21	1.7	7.55	T-piece DN200/100	2.96	0.2	1.2	Cast iron	253
3	0.02	0.002	1.52	6.4	T-piece DN200/100	8.02	0.05	0.1	Cast iron	240
4	0.39	0.22	0.37	0.45	T-piece DN250/250	2.23	0.2	1.56	Cast iron	300
5	0.02	0.002	2.14	11.96	T-piece DN200/100	3.4	0.11	0.1	PE	159
6	0.23	0.19	0.67	1.33	T-piece DN150/100	1.53	0.25	1.53	Cast iron	75
7	0.27	0.24	0.39	0.47	T-piece DN250/100	1.86	0.15	1.08	Cast iron	170
8	0.02	0.002	0.77	1.72	T-piece DN200/100	3.94	0.18	0.1	Cast iron	295
9	0.27	0.24	1.13	3.6	T-piece DN250/150	5.6	0.17	1.08	Cast iron	204
10.1	0.21	0.15	0.46	0.62	T-piece DN250/200	1.4	0.29	0.84	Cast iron	745
10.2	0.21	0.15	0.46	0.62	T-piece DN150/150	2.75	0.22	1.4	Cast iron	400
11.1	0.21	0.15	0.52	0.81	T-piece DN250/200	1.53	0.2	0.84	Cast iron	745
11.2	0.21	0.15	0.52	0.81	T-piece DN150/150	1.52	0.2	1.4	Cast iron	400
12	0.02	0.002	1.39	5.01	T-piece DN150/150	2.7	0.17	0.133	Cast iron	245
13	0.04	0.004	1.5	5.97	T-piece DN100/100	1.16	0.14	0.4	PE	360
14	0.25	0.22	0.54	0.86	T-piece DN200/100	3.35	0.15	1.25	Cast iron	170

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc


Printer-friendly Version

Interactive Discussion



## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

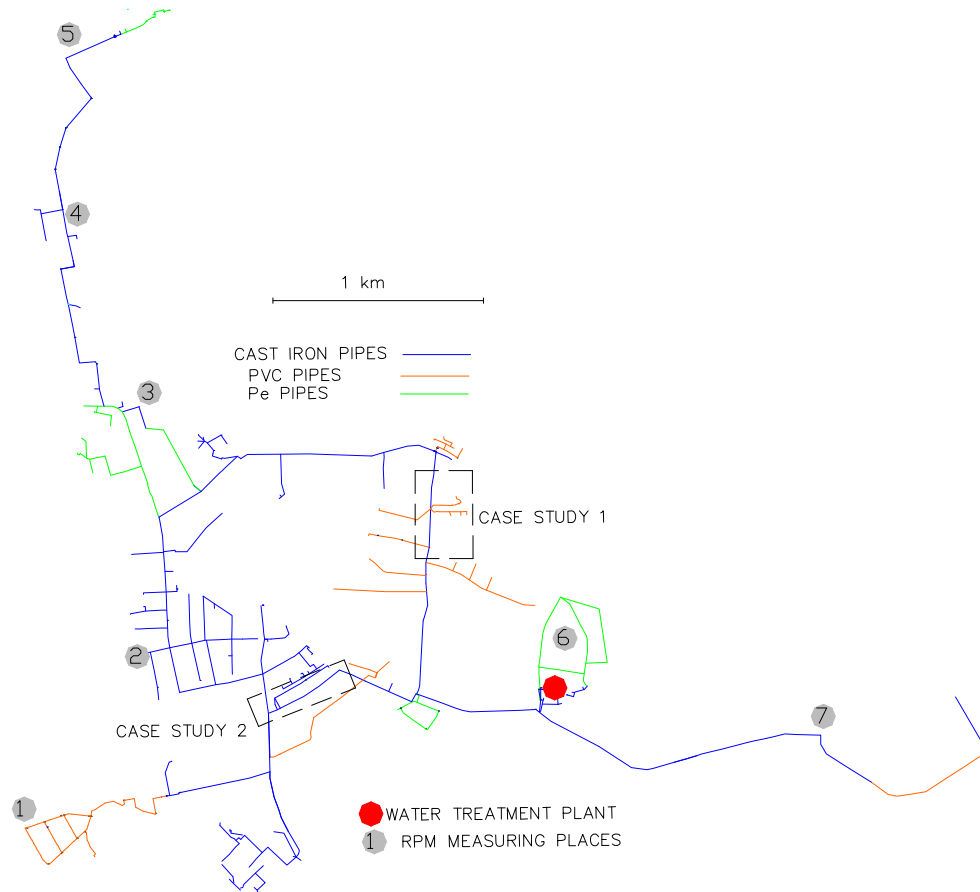


**Fig. 1.** The diagram of drinking water network; numerated circles indicate locations of the resuspension potential method. The sites described in results Sect. 3.2 are indicated with a dashed line. The CI pipes are shown in blue, PVC pipes are shown in orange, and the PE pipes are shown in green.

[Title Page](#)
[Abstract](#)
[Introduction](#)
[Conclusions](#)
[References](#)
[Tables](#)
[Figures](#)
[⏪](#)
[⏩](#)
[⏴](#)
[⏵](#)
[Back](#)
[Close](#)
[Full Screen / Esc](#)
[Printer-friendly Version](#)
[Interactive Discussion](#)

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

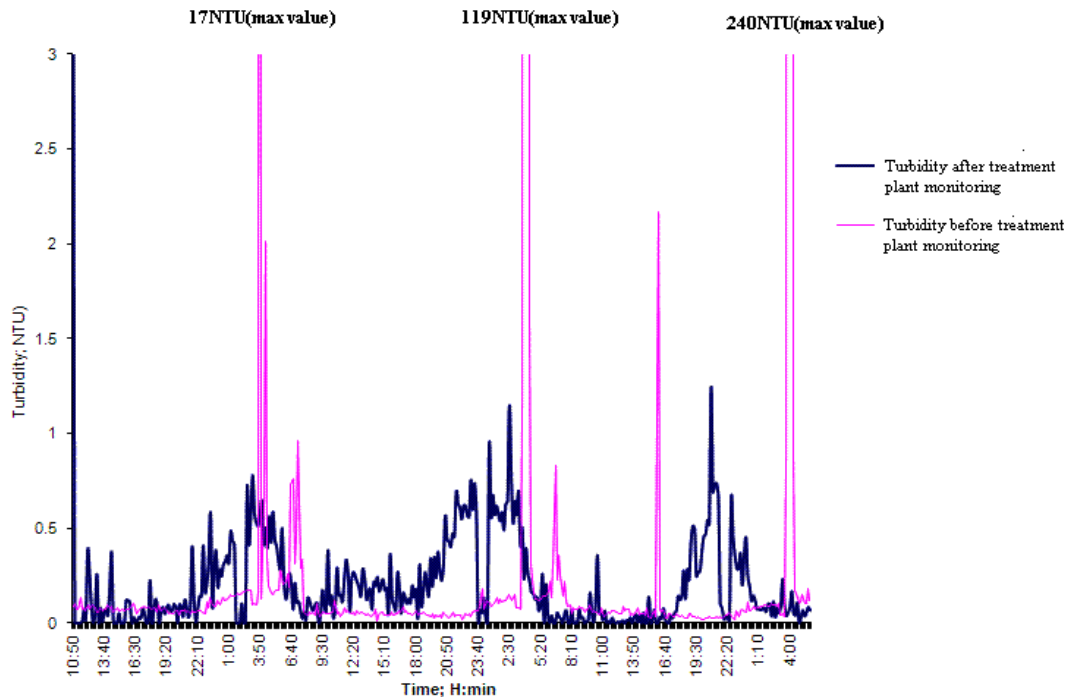

**Fig. 2.** The online measurements of turbidity in the outlet of the water treatment plant of the distribution network before and after the repair of the rapid sand filters. Values on the top of the figure show the peaks of turbidity. Modified from Neilands et al. (2009).

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures



Back

Close


Full Screen / Esc

Printer-friendly Version

Interactive Discussion


## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

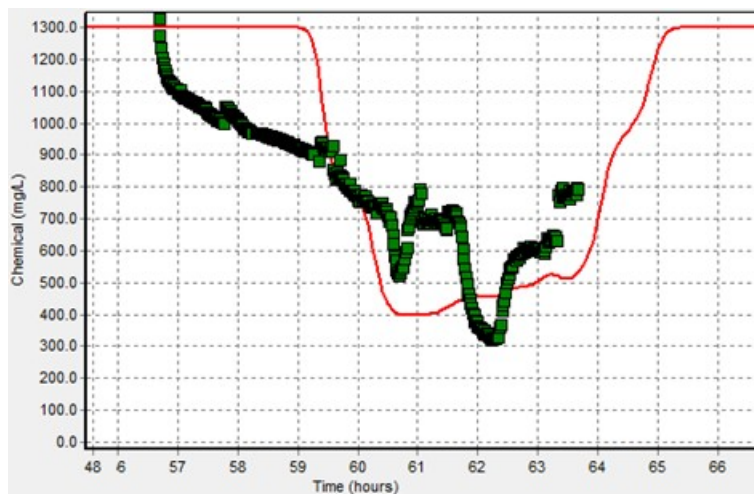

**Fig. 3.** Measured (green squares) and modeled (red line) concentrations of tracer near RPM measurement location No. 3 (see Fig. 1).

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[⏪](#)[⏩](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

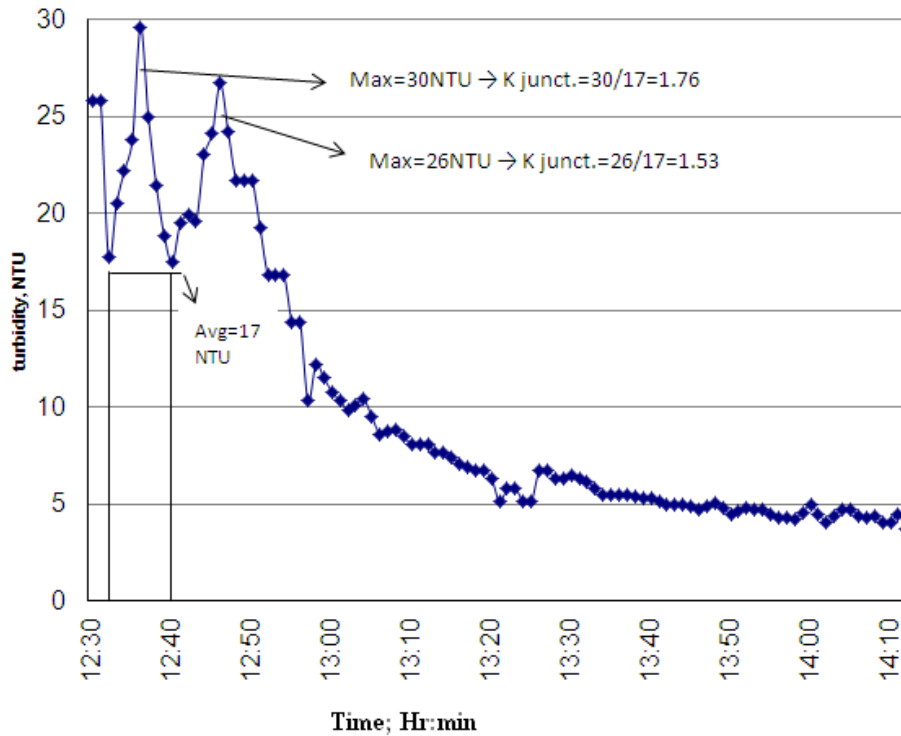

**Fig. 4.** The turbidity pattern from the UDF and schematic (graphical) representation for obtaining the algorithm for the  $J$  coefficient for a certain location.

**Accumulation and modeling of particles in drinking water pipe fittings**

K. Neilands et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

**Accumulation and modeling of particles in drinking water pipe fittings**

K. Neilands et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[⏪](#)

[⏩](#)

[◀](#)

[▶](#)


[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

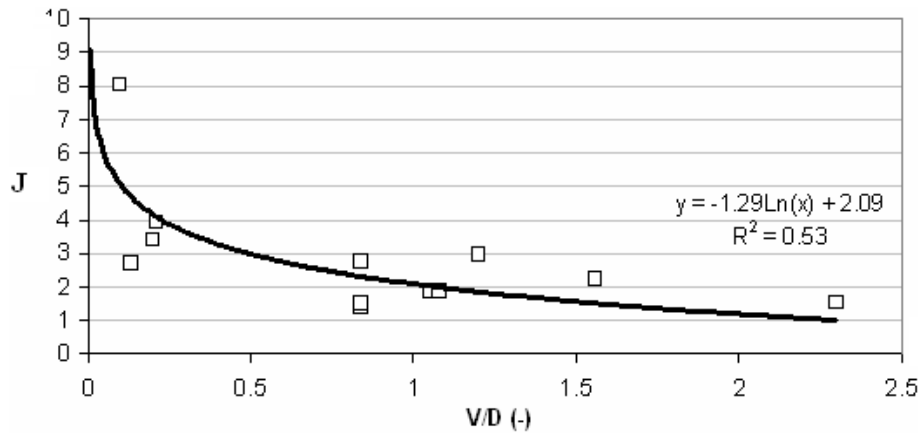


**Fig. 5.** Turbidity potential of accumulated particles ( $J$ ) in T-pieces versus hydraulic conditions.

Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper

## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

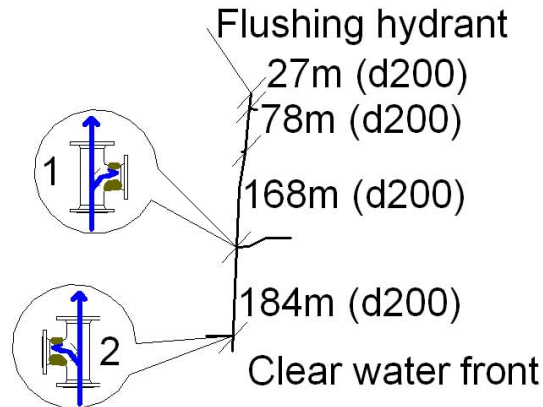

**Fig. 6.** The section of the CI pipe layout for site 1 (see Fig. 1). The locations of hydrant and fittings are indicated. The T-piece with reduction on the right and left respectively to 100 mm is indicated under No. 1 and 2. The diameters of pipe segment in mm is shown in brackets.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

⏪

⏩

◀

▶

[Back](#)

[Close](#)

[Full Screen / Esc](#)


[Printer-friendly Version](#)

[Interactive Discussion](#)



**Accumulation and modeling of particles in drinking water pipe fittings**

K. Neilands et al.

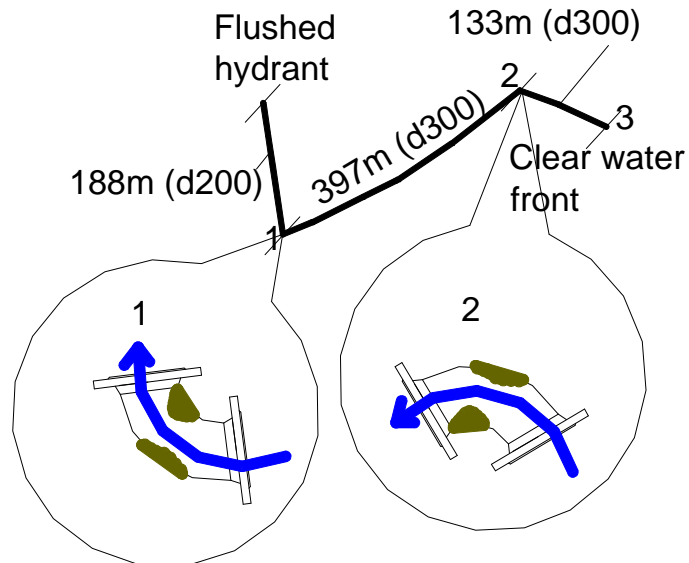


**Fig. 8.** The section of the CI pipe layout (see Fig. 1) with two 90° bends indicated with No. 1 and 2. The diameters in mm are shown in brackets.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[⏪](#)[⏩](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)



## Accumulation and modeling of particles in drinking water pipe fittings

K. Neilands et al.

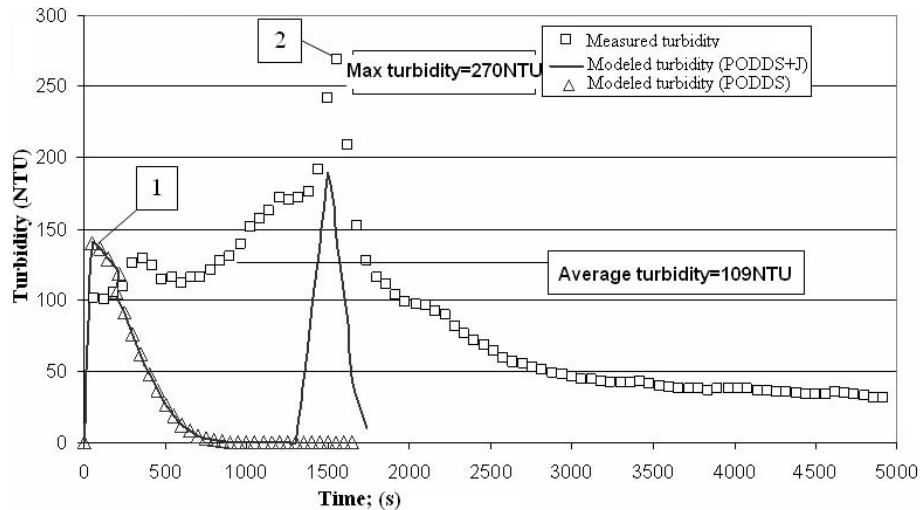

**Fig. 9.** Turbidity curve for flushing site 2 containing two 90° bends. With No. 1 and 2 are indicated location of accumulated particles in to the bends (see Fig. 8) find by using the principle of back-tracking.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion