

This discussion paper is/has been under review for the journal Drinking Water Engineering and Science (DWES). Please refer to the corresponding final paper in DWES if available.

Low-cost multi-stage filtration enhanced by coagulation-flocculation in upflow gravel filtration

L. D. Sánchez¹, L. M. Marin¹, J. T. Visscher², and L. C. Rietveld³

¹Universidad del Valle, Facultad de Ingeniería, Instituto Cinara, Cali, Colombia

²JTF-Rotterdam BV, Rotterdam, The Netherlands

³Delft University of Technology, P.O. Box 5084, 2600 GA Delft, The Netherlands

Received: 18 January 2012 – Accepted: 5 June 2012 – Published: 29 June 2012

Correspondence to: L. D. Sánchez (luis.sanchez@correounivalle.edu.co)

Published by Copernicus Publications on behalf of the Delft University of Technology.

DWESD

5, 291–332, 2012

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Abstract

This paper assesses the operational and design aspects of coagulation and flocculation in upflow gravel filters (CF-UGF) in a multi-stage filtration (MSF) plant. This study shows that CF-UGF units improve the performance of MSF considerably, when the system operates with turbidity above 30 NTU. It strongly reduces the load of particulate material before the water enters in the slow sand filters (SSF) and therewith avoids short filter runs and prevents early interruption in SSF operations. The removal efficiency of turbidity in the CF-UGF with coagulant was between 85 and 96 %, whereas the average efficiency without coagulant dosing was 46 % (range: 21–76 %). Operating with coagulant also improves the removal efficiency for total coliforms, *E-coli* and HPC. No reduction was observed in the microbial activity of the SSF, no obstruction of the SSF bed was demonstrated and SSF runs were maintained between 50 and 70 days for a maximum head loss of 0.70 m. The most important advantage is the flexibility of the system to operate with and without coagulant according to the influent turbidity. It was only necessary for 20 % of the time to operate with the coagulant. The CF-UGF unit represented 7 % of total construction costs and the O&M cost for the use of coagulant represented only 0.3 %.

1 Introduction

Water quality and quantity from surface sources are changing due to the deterioration of watersheds caused by deforestation, erosion, and the discharge of untreated wastewater (e.g., in Colombia only 3.1 % of the total volume of wastewater produced is treated, CGR, 2009). These changes are intensified by the global climate change causing longer dry periods on the one hand and more intense rainfall on the other (Bates et al., 2008). The two most serious problems concern the peaks in turbidity level and high *E-coli* concentrations of long duration. These changes are affecting the existing water treatment plants, causing higher operation and maintenance (O&M) requirements

DWESD

5, 291–332, 2012

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



and even interruptions in their operation (Bates et al., 2008). These growing water quality problems are not unique for Colombia but imply a significant challenge in the Andean region, because surface water is the main source in the water supply systems (Sánchez and Galvis, 1998). In Colombia about 80 % of the water supply systems are based on surface water supply (Ministerio de Desarrollo, 1998). The problems particularly affect water supply systems in rural areas and small towns, many of which even lack adequate water treatment.

Multi-Stage Filtration (MSF) is one of the more promising and reliable water treatment options for small communities. This technology uses a combination of gravel filtration (GF) in combination with slow sand filtration (SSF). Upflow gravel filtration (UGF) is the most common pre-treatment system used for MSF in Colombia (Galvis and Visscher, 1998). In UGF the water passes through the gravel bed from bottom to top. During this passage impurities are retained in the filter. Upflow filtration has the advantage that the heavier particles are removed first at the bottom of the filter. Burganos et al. (1994) have reported that upflow units have an increased collection efficiency at small and medium pore inclination angles. This concept is interesting for the theoretical analysis of particle motion and deposition, but complex to manage in practice. When the time comes to clean the filters, the accumulated particles can be removed by opening the drainage valve, allowing gravity flow to drain and clean the filter.

Research carried out by Cinara over more than 15 yr showed that different MSF alternatives that were tested, including UGF (filtration rate, $V_f = 0.6 \text{ m h}^{-1}$) and SSF (operating at 0.15 m h^{-1}), were able to produce effluents with a low microbial risk (Galvis, 1999). Research also explored the use of coagulation and flocculation with UGF, called CF-UGF, focusing, in pilot plants, on the combination with rapid filters (RF). The results showed a reduction in the consumption of coagulants by up to 30 % compared to the conventional system of coagulation, flocculation and high rate sedimentation (Cinara and IRC, 1996).

Other research into CF-UGF has emphasized the laboratory variables and the removal efficiencies. Richter and Moreira (1981) reported that a flocculation time of

**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

3–5 min in a UGF is equivalent to a time of 15 min in the jar test under laboratory conditions and 25 min in non-compartmentalized flocculation units in full-scale plants. Santamaría (1999) showed that, using UGF, the flocculation time can be reduced by up to 60 % compared to mechanical flocculators; Salazar and Ocampo (1999) found that in CF-UGF, producing the same water quality would require between 10 and 20 times less retention time compared to a sludge blanket clarifier; Kawamura (1985), working on pilot units with UGF and RF, reported a turbidity removal of 50 %; Ahsan (1995) found that horizontal gravel filtration (HGF) with coagulation removes more particles compared to the HGF without chemicals. In addition, studies with different packed gravel beds found that a stratified bed is more efficient than a uniform bed (Attakoya et al., 1991). Different studies have contributed to refining the parameters for design and operation and maintenance which have been defined by Di Bernardo (1993). However, the use of CF-UGF with MSF has had few full-scale applications. Full-scale experiences using UGF based on conventional technology with rapid filtration as a final stage were reported by Kardile (1981), working with a $V_f = 4\text{--}10\text{ m h}^{-1}$ and turbidity levels between 300–500 NTU, achieving construction costs between 30 to 50 % less than conventional systems of equal capacity. Bohle (1981) reported a velocity gradient in a truncated pyramid filter of $G = 1230\text{ s}^{-1}$ at the bottom layer and 35 s^{-1} at the upper layer with a $V_f = 11.3\text{ m h}^{-1}$. More recent studies indicated that aluminium residual has not shown any effects on biological activity in SSF, when coagulation with aluminium sulphate has been used, Dorea and Clarke (2006). This indicates that the addition of coagulant with UGF has potential to improve the performance of MSF during variations in influent water quality, conserving biological processes in the following stages. Consequently full-scale evaluations are necessary to better understand the design variables and operation and maintenance conditions.

The community of Colinas de Arroyo Hondo, located in a rural area of Yumbo municipality, Colombia, had a treatment plant functioning with the processes of coagulation, flocculation, sedimentation, rapid filtration and disinfection with chlorine and ultraviolet light. However, in field studies on water quality in the distribution network, biofilms were

**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

found in the pipes, which generated problems of re-growth of micro-organisms in the water supplied to the users (average values of 2183 CFU (100 ml)⁻¹ for heterotrophic bacteria, 7 CFU (100 ml)⁻¹ for *E-coli*, and 39 CFU (100 ml)⁻¹ for total coliforms were also found at four points in the distribution network). In the treatment plant, which had been operating for 4 yr, failures were identified in its functioning, allowing solids and micro-organisms to pass into the distribution system. After an investigation, the treatment system was redesigned and rebuilt to CF-UGF with MSF. This new system has been in operation for 7 yr at the time that this evaluation study was carried out.

This paper assesses the performance and the design aspects of the CF-UGF units followed by UGF and SSF, defining influent turbidity levels to allow operation with and without coagulant, taking advantage of the SSF as the final stage of filtration for the removal of microorganisms.

2 Materials and methods

2.1 Set-up of the treatment system

In Fig. 1 the set-up of the CF-UGF MSF plant is shown. The system operation is performed by pumping raw water to the plant and then, after treatment, pumping it into the distribution network. The system uses two pumping flow rates: 6 l s⁻¹, which is the maximum capacity for 12 h during the day and 3 l s⁻¹ for another 12 h at night. The treatment plant consists of 5 components. Raw water passes through the flow control unit in the dynamic roughing filter (DRF), whose main function is to protect the next steps from excessive loads of suspended solids and turbidity. Filtered water flows into a rapid mixing chamber (RMC), where the coagulants are dosed. Afterwards, the water enters the CF-UGF stage which consists of 2 units in parallel, where the processes of coagulation, flocculation, sedimentation and filtration of destabilized particles occur. Water is collected in a front weir to later enter the UGF where remaining flocculated

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



particles are removed in the different layers of gravel. From there, the water enters the SSF stage for final removal of suspended particles and microorganisms.

The RMC unit allows a proper rapid mixing time and a velocity gradient, while the CF-UGF unit facilitates flocculation and deposition of particles. The hydraulic RMC operates through a rectangular weir that allows free flow of water to form a hydraulic jump for mixing the coagulant with the raw water. Above the RMC a channel provided with holes is installed to distribute the coagulant and initiate the destabilization of the particles, which will be removed in the CF-UGF and the UGF. The RMC is divided into 3 compartments, one for arrival and energy dissipation, one for mixing and one for the outlet of the coagulated water to the CF-UGF. Table 1 lists the parameters considered for the design of the unit, the formulae and the values obtained during the operation, while Fig. 2 shows the layout of the CF-UGF unit.

The CF-UGF step consists of 2 units in parallel and forms the third component in the treatment scheme. The system has 4 layers of gravel bed and was designed as a truncated pyramid to facilitate variation in the velocity gradient, producing a variable gradient from the highest to the lowest value from the bottom to the surface of the unit. In Table 2 the values of the velocity gradient for two flow operations are listed, depending on the properties of the filter bed and the average fluid velocity in each gravel layer, the cross-sectional area of the filter and the head loss in the bed. The calculation of the velocity gradient was done by Eq. (4) (see Table 1), proposed by Ergun (1952), which is valid for any flow regime as long as the bed is not fluidized (Di Bernardo, 1993).

The flocculation gradient is greater at the bottom of the bed, decreasing towards the top of the filter, basically to promote the formation of flocs (Fair et al., 1984). It should be noted that the velocity gradient values were lower than those reported by Ahsan (1995) (200–300 s⁻¹) because the filtration rate in CF-UGF was lower. The Reynolds numbers indicate that the units work in the hydraulic transition regime; values obtained above 10 indicate a stable inertial regime for flocculation in the porous medium, as reported by

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Wright (1968). For the calculation of the head loss in the filter the Ergun equation was used.

The calculations for each barrier of the treatment system were done on the basis of the design parameters presented in Table 3 and the dimensions of each barrier in Table 4. The optimal dose of coagulant for operation of the CF-UGF system was defined according to the results of jar tests; the rapid mixing intensity and the slow mixing during the jar test were expressed in the velocity gradient G (s^{-1}) following the method described by Castro and Pérez (1981) and were used for a first approximation of the velocity gradient in the CF-UGF.

2.2 Monitoring water quality and system operation

During the study, the raw water was monitored for the following parameters: turbidity, true colour, *E-coli*, total coliforms, heterotrophic bacteria plate count (HPC) and pH. The water quality parameters and related methods are listed in Table 5. Measurements of the head loss (h_f) over the filter bed were done for short periods of operation (4–6 h), when coagulants were applied. However, when operating without coagulant, daily measurements were done during periods of 8 days, according to the schedule defined by the plant operators for cleaning the CF-UGF and UGF. This is because with time large quantities of solids will accumulate within the gravel bed and then filter resistance will increase gradually and the water level within the inlet chamber will rise to a maximum h_f . To facilitate the measurements of h_f , steel rules were installed in the inlet chamber, taking care that the zero of the rule coincides with the water level in the chamber for the no-flow condition.

Jar tests were carried out following the method presented by Di Bernardo (1993), where rapid mixing is done using jar test equipment with 2-liter glass jars. The coagulant used was 50 % liquid aluminium sulphate diluted with water to 2 %, and was added for a period of 60 s at a velocity gradient greater than 300 rpm. After rapid mixing, water was extracted and filtered in a funnel containing filter paper Whatman 40 (pore size

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



8 μm), to obtain a volume sufficient to realize analyses. The procedure for conducting the jar tests is presented in Table 6.

Tracer tests were performed according to the methodology described by Pérez and Galvis (1990), in order to understand the hydraulic performance of the CF-UGF and UGF units. Trials were conducted following the experimental stimulus-response method, in which a tracer, easily detectable and not involved in any of the physical and chemical processes that may alter the actual fluid hydrodynamics and with a known concentration, is injected into the influent (Rocha et al., 2000). The concentration curve of the tracer was analysed to determine the portion of plug flow, dead zones, and the fraction that works as a completely mixed flow. These tests were conducted using sodium chloride. The substance was dosed continuously through a constant hydraulic head dispenser with a sodium chloride concentration between 50–100 mg l^{-1} . The dosing period was three times the theoretical retention time of each unit and the response was measured at the output of each unit by means of electrical conductivity. Measurements were taken after the CF-UGF unit every 2 min. Results were analysed with the mathematical model Wolf-Resnick, the Morril Index (relationship between the time between the 90% and the 10% passage of the tracer), and the model of completely mixed reactors in series (CMRS), (Pérez and Galvis, 1990; CEPIS, 2004). Wolf-Resnick model Eq. (7) indicates that by plotting the fraction of tracer remaining in the filter ($1 - F(t)$) versus $T t_o^{-1}$ (relationship between measured time and the theoretical retention time), it is possible to estimate the values θ and $\tan \alpha$ (the slope of the straight line), and to identify the characteristics of the reactor using Eqs. (8) to (11). CMRS model was analyzed using Eq. (12), where n is the number of reactors in series and $C C_o^{-1}$, is the relationship between the concentration of tracer which remains in the reactor at a time and the concentration of tracer applied.

$$\log 1 - F(t) = -\tan \alpha [(t/t_o) - p(1 - m)] \quad (7)$$

$$\tan \alpha = (0.434 \cdot p) / (\theta \cdot (1 - p)) \quad (8)$$

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



$$\text{Plug flow } (\theta) : \theta = \rho(1 - m) \quad (9)$$

$$\text{Dead zones } (m) : m = 1 - (\theta/\rho) \quad (10)$$

$$5 \text{ Mixed flow } (M_f) : M_f = (1 - \rho)(1 - m) \quad (11)$$

CMRS model :

$$\frac{C}{C_o} = n \left[\frac{(n \cdot \frac{t}{t_o})^{n-1}}{(n-1)!} \right] \left(e^{-n \cdot \frac{t}{t_o}} \right) \quad (12)$$

10 The porosity (ε_0) of the filter material was determined following the procedure defined by Ives (1990): first, the mass (M) occupied by the sample of gravel in a container of known volume and the apparent volume (V) occupied by the gravel in the container were both measured; then the density (ρ_s) of the gravel was determined by the ratio between the mass of the sample and the volume occupied by the sample. The porosity was calculated by Eq. (13).

$$15 \quad \varepsilon_0 = 1 - M/\rho_s V \quad (13)$$

The filter cleaning procedure was the following: the water inlet to the unit was interrupted; without removing the supernatant water the surface of the gravel bed was cleaned manually with a shovel, stirring the surface layer of the filter to remove solid material adhering to the gravel; the supernatant water with the removed deposits from the top of the filter bed was discharged through a front weir; then the filter was prepared for removal of the deposits in the filter by adding water to the unit by opening the flow control valve in the inlet chamber to restore the supernatant water layer and increasing its height to a level of water between 20–25 cm above the gravel in the main compartment; this increased height adds some pressure for the cleaning procedure, in which fast drainage was carried out by quickly opening and closing (some 10 times) the butterfly valve on the underdrains; the unit was thereafter refilled with water and the

cleaning and drainage procedure was repeated for adequate cleaning of gravel; then the filter was put back into operation.

The flow rate (Q) of the draining procedure in the UGF units was determined by the following procedure: (a) the unit was filled to the maximum level of the top; (b) the water flow into the filter was interrupted; (c) the surface area was measured (A); (d) the butterfly valve was opened until the water level lowered by 5 cm; (e) the declining water level (Δh) was measured over time (t) and (f) the initial flow rate was set by the expression $Q = \Delta h \cdot A/t$ ($\text{m}^3 \text{s}^{-1}$).

3 Results and discussion

3.1 Water quality of the source water

The water source is a small mountain river (the Arroyo Hondo River) which drains an area that has problems of deforestation and erosion, strong activity in the basin of rocky material exploitation for construction and discharge of untreated wastewater. The behaviour of microbiological parameters over a 3-month period indicated that the source has, according to Lloyd and Helmer (1991) and WHO (2011), a high microbiological risk, because faecal coliform values at all times exceeded $1000 \text{ CFU (100 ml)}^{-1}$. *E-coli* bacteria were below $4.2 \text{ logs CFU (100 ml)}^{-1}$ for 95 % of the time, but were never less than $3.2 \text{ logs CFU (100 ml)}^{-1}$. The average values of HPC and total coliforms were $5.3 \text{ logs CFU (100 ml)}^{-1}$ and $5.1 \text{ logs CFU (100 ml)}^{-1}$, respectively.

The behaviour of turbidity in the source was measured for a period of one year. This parameter, which is easy to measure, is a good indicator to control the system and facilitates decision-making by the operator. The results indicated that the turbidity in the source did not exceed 100 NTU for 97 % of the time, while the turbidity was lower than 25 NTU for 75 % of the time. Minimum values of 3 NTU were recorded during the summer period and maximum values of 350 NTU during the rainy season. Turbidity peaks were of short duration (4–6 h) but sometimes lasted up to 24 h. For 95 % of the

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



time the true colour level in the river was below 25 UPC and at no time the level dropped below 5 UPC.

3.2 Coagulant dosage

Figure 3 presents the results of the optimal dose of aluminium sulphate for different turbidity levels. The dosage behaves as a logarithmic function. The results correspond to: rapid mixing time 60 s, gradient of rapid mixing 300 rpm ($G = 280 \text{ s}^{-1}$), slow gradient mixing of 60 rpm ($G = 28 \text{ s}^{-1}$), slow mixing time 25 min, and sedimentation time of 20 min. The optimum pH for optimum dosing was in the range of 6.6–7.6 for an alkalinity between 59–133 mg (l CaCO₃)⁻¹.

3.3 Hydraulic behaviour of CF-UGF units

Figure 4 shows the results of the mathematical model Wolf-Resnick. The model results for CF-UGF indicate that the system worked with a plug flow fraction of 51 %, a mixed fraction of 46 % and a dead zone fraction of 3 % ($r^2 = 0.90$). Taking into account the dead zones in the CF-UGF, the velocity gradient in the unit varied between 3.2 and 29.4 s⁻¹, which is close to the value calculated in Table 2 and obtained in the jar test to optimize the coagulant dose. The Morrill Index (MI) was 1.82, which suggests, according to experiments by Perez and Galvis (1990), the predominance of plug flow in the CF-UGF unit. Figure 5 presents the results of the CMRS model. The continuous lines show the hydraulic behaviour with n reactors in series, while the dotted line represents the measurements at the CF-UGF unit. When comparing the results of the theoretical model with experimental data, the hydraulic behaviour of the reactor CF-UGF tends to $n = 6$ reactors in series (see continuous black curve, Fig. 5), confirming the presence of a relative plug flow. The mean residence time (t_m) was estimated from the experimental curve, determining the centroid under the curve, the mean residence time for the CF-UGF was 19.7 min for the flow of 3 l s⁻¹ while theoretical retention time was 19 min. These differences may be explained by the presence of dead zones and implies that

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



the curve of distribution residence time has a tail and therefore the time will be displaced in the time axis (Fig. 5), the fluid elements that were trapped in the dead zones is conducted very slowly and will have a much larger residence time.

3.4 Removal of turbidity in the operation without coagulant

The operation of the CF-UGF without coagulant dosing was used in dry periods. Figure 6 shows the frequency of turbidity in raw water and after different treatment barriers, including DRF, CF-UGF, UGF and SSF. The CF-UGF units produced an effluent between 2.5–7.5 NTU, with mean removal efficiency of 46 %, while for 78 % of the time the UGF showed turbidity levels lower than 1 NTU and another 22 % were between 1.5–2 NTU. SSF units processed water with 0.3 NTU for 98 % of the time. CF-UGF and UGF always produced water with turbidity levels below 10 NTU, which is the guideline value of inflow water to the SSF units, according to Di Bernardo (1993) and to Galvis et al. (1999) who add the requirement that filtration rates should be lower than 0.20 m h^{-1} in SSF units. In this case it was a little higher because the system operated at filtration velocities of between 0.15 and 0.30 m h^{-1} ($3\text{--}6 \text{ l s}^{-1}$).

3.5 Removal of turbidity in the operation with coagulant

Figure 7 shows the frequency of turbidity in raw water and different treatment barriers, when the CF-UGF is operated with coagulants. The application of coagulant in the RMC varied as indicated in Fig. 3. In the effluent CF-UGF units, for 97.2 % of the time turbidity levels lower than 10 NTU were achieved, while the maximum value of turbidity in the effluent in this step ranged between 15–20 NTU for 1.4 % of the time. The UGF showed turbidity levels lower than 6 NTU for 100 % of the time, thereby facilitating the operation of the SSF, which produced water with turbidity below 1 NTU for 98 % of the time. The addition of coagulant in the CF-UGF enabled water with turbidity levels below 10 NTU after UGF to be obtained. Increments in turbidity levels, which occur basically in the rainy season, could be managed in the treatment plant by the CF-UGF unit,

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

⏪

⏩

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



which contributed to an effective operating system, preventing reductions in the SSF filtration runs. Additionally, stops in the operation of the treatment plant were prevented.

The removal efficiency of turbidity in the CF-UGF with coagulant was between 85 and 96 %, which is higher compared to operating without coagulant, and average efficiency of turbidity in the CF-UGF was 46 %, ranging between 21–76 %. The removal efficiencies in CF-UGF with velocity gradients between 28.5–3.1 s⁻¹ (for 3 and 6 l s⁻¹) was consistent with the findings of Di Bernardo and Sabogal (2009), who established that the gradient must be less than 100 s⁻¹. The efficiency in the removal of turbidity can be explained by the good opportunities for contact with particles in the gravel bed, which is consistent with Richter (1987), Attakoya et al. (1991), and Di Bernardo and Cruz (1994).

3.6 Removal of microorganisms in the operation without coagulant

When operating without aluminium sulphate, the duration of the filter run was 8 days in the CF-UGF and UGF, regardless whether it achieved the maximum head loss or not (normally head loss is less than 5 cm in 8 days, to a maximum value of 15 cm). The typical removal of microorganisms for a filter run is presented in Table 7 for samples taken in the influent of CF-UGF unit and the effluent of the UGF. The removal efficiency in the CF-UGF and UGF steps was 0.16 logs for total coliforms, 0.16 logs for *E-coli* and 0.17 logs for HPC, lower than that reported by Galvis et al. (1999), which was probably due the effect of a higher filtration rate. SSF achieved a total reduction of *E-coli* of 3.2 log units, facilitating the work of chlorination as a security barrier. These results are consistent with the WHO (2011) which indicated that the range of log removal of bacteria for SSF must be between 2–6 under presence of schmutzdecke and appropriate: grain size, flow rate, operating conditions (mainly temperature, pH), cleaning and refilling and in the absence of short circuiting.

The reduction of the filtration velocity in the UGF from 0.9 to 0.5 m h⁻¹ contributed to improved efficiency in the removal of microorganisms. The average removal for total coliforms and *E-coli* was 0.57 and 0.5 logs respectively in CF-UGF and UGF steps, while

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



HPC reached a removal of 0.64 logs. These reductions are close to those reported by Galvis et al. (1999). The average removal in SSF was 3.0 logs. The efficiency of the SSF was not influenced by changes in the filtration rate, probably due to the high level of maturity of the filters.

3.7 Removal of micro-organisms, operation with coagulant

Table 8 presents the results of operating with coagulant, the data correspond to samples taken in the influent of CF-UGF unit and the effluent of the UGF for a period of 6 h, because when turbidity was less than 30 NTU the coagulant dosing was stopped. The dose of aluminium sulphate corresponded to 10 mg l^{-1} , with an operation flow of 6 l s^{-1} . Overall, the pre-treatment with CF-UGF and UGF contributed to the reduction of microbiological load: average 0.44 log removal for total coliforms, 0.40 log removal of *E-coli*, and 0.44 log removal for HPC. Only the CF-UGF unit contributed with average efficiencies for total coliforms equivalent to 0.19 log, 0.12 logs for *E-coli* and 0.15 log for HPC. The last stage of treatment, SSF, allowed a total reduction of 3.4 log of total coliforms, 3.1 log for *E-coli*, and 3.9 log of HPC. This suggests that the dosage of aluminium sulphate did not affect the biological activity in pre-treatment and SSF, which is consistent with that reported by Dorea and Clarke (2006).

When comparing operation with and without coagulant an increase in the average efficiency of removal of microorganisms, between 0.16–0.17 log to 0.40 to 0.44 log was observed, i.e. in the operation with coagulant the removal efficiency for total coliforms, *E-coli* and HPC, was 2.75, 2.5 and 2.6 higher respectively compared to the operation without coagulant in the CF-UGF and UGF units.

3.8 Aluminium, pH, colour and organic matter

Residual aluminium in the system was low in the effluent of CF-UGF and 53% was removed in the UGF, so that the concentration in the influent of the SSF varied between 0.07 and 0.09 mg l^{-1} , and the average effluent concentration was 0.04 mg l^{-1}

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



(STD 0.005 mg l⁻¹). This value was lower than the WHO (2011) guidelines, which recommended less than 0.2 mg l⁻¹ for aluminium in drinking water. In a pilot study that examined the impacts of chemical pre-treatment by gravel filters on SSF Dorea and Clarke (2006), reported an average aluminium concentration of 0.041 mg l⁻¹ in the effluent of the SSF and indicated that the chemical improved the overall treatment efficiency. The filter runs of SSF were maintained between 50 and 70 days with a maximum head loss of 0.70 m, which is in line with the range of 20–60 days reported by Schulz and Okun (1984), the minimum of 45 days recommended by Cleasby (1991) and the range of 46–178 days recommended by Galvis et al. (1999). The pH in the influent varied between 8.2 and 8.5 and between 8 and 8.2 in the effluent of CF-UGF, which is expected not to affect the biological development of the Smutzdecke in the SSF, respect Galvis et al. (1999) reported pH in the range of 7.1–8.0 for operation of SSF and indicate that the adsorption of virus the sand improves with increasing ion concentration and valence of the cations in solution. The true colour reduction recorded an average efficiency of 54 % in the CF-UGF stage and 57 % in the UGF stage, and the net efficiency of the true colour reduction of the CF-UGF and the UGF stage together was 76 %. The organic matter content measured as total organic carbon (TOC) was low, the influent had an average value of 1.1 mg l⁻¹ (± 0.075), and the removal efficiency in the CF-UGF and UGF step together was 9 %, with an efficiency at the end of the treatment of 28 %.

3.9 Operation and maintenance

The treatment plant operated without coagulant for turbidity levels below 30 NTU. When influent turbidity was greater than 100 NTU, operators interrupted the operation to reduce the turbidity load on the plant and, depending on water needs, operated with coagulant, reducing the filtration rate by half. When rain events occurred and the influent turbidity was greater than 30 NTU, a dosage of coagulant was applied. Figure 8 shows the behaviour of turbidity in CF-UGF and UGF and head loss in the CF-UGF

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



units for an event of short duration when the turbidity increased above 30 NTU up to a maximum value of 58 NTU, and operation with coagulant was necessary. The monitoring of the head loss was only done in the CF-UGF units. In the UGF unit, there was no change in head loss detected in the relatively short period of the event. The total loss over a period of 4 h of operation was 3.5 cm and did not achieve the maximum value of 20 cm. Table 9 summarizes the operating and monitoring conditions.

Based on the information registered by the operators of the water treatment plant, cleaning frequency for the CF-UGF and the UGF units was every 8 days (without a coagulant dosage). During the rainy period the CF-UGF units, operating with aluminium sulphate, registered cleaning frequencies in the range of 6–100 h. The cleaning frequency of 6 h was obtained when influent turbidity reached values of above 100 NTU, while the 100-h operation mode was observed when influent turbidity levels were between 30–60 NTU.

The behaviour of the cleaning of the CF-UGF in terms of turbidity is presented in Fig. 9. In the CF-UGF, cleaning was done by operating the butterfly valve in such a way that 10 shock waves were created. It can be observed that, for the CF-UGF, in the first 15 s of the discharge a turbidity peak occurred, for 35 s the water was clear, and then after 85 s a second peak was observed. For the UGF, the solids discharge started immediately to reach a second peak after 150 s, about 5 times higher than the first peak. The behaviour of the water quality in the discharge of the wash water was different from that reported by Wolters (1988) and Cinara and IDRC (1993). When the valve was opened suddenly, the particles which stayed on the filter media experience a change in velocity, whose effect may be to drag the particles to transport to the drainage system.

The flow rate of the drain water for cleaning the filter was variable over time; measurements were done for different heights of water level relative to the position of the butterfly valve. The maximum backwashing rate for the UGF was 9.4 m h^{-1} while for the CF-UGF it was 9.1 m h^{-1} .

Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

3.10 Investment, operation and maintenance costs

Tables 10 and 11 list the construction costs (year 2011) and operation and maintenance costs (year 2010). The CF-UGF stage represented only 7 % of the total construction costs, and the pre-treatment by CF-UGF and UGF represented 35 % of the total costs.

5 The costs per m^3 of produced water was US \$ 0.05 (discount rate of 12 % for Colombia and project horizon of 15 yr). Per capita investment costs are US \$ 18, for an average consumption of $150 \text{ l c}^{-1} \text{ d}^{-1}$. The costs of O&M for the use of coagulant are low, representing only 0.3 % of total O&M costs, because the operator only doses in periods of high turbidity, making the technology attractive. The highest costs of O&M represent
10 pumping energy and staff. The O&M costs of US \$ 0.264 m^{-3} is low (depreciation was included), when compared to the costs of US \$ 1.04 m^{-3} (includes the average investment costs) for the utility of the city of Cali, close to the community. The O&M costs in a gravity system would reduce to US \$ 0.14 per m^3 .

4 Conclusions

15 CF-UGF is a relatively new technology that has been applied in a few cases with rapid sand filtration. In this study CF-UGF has been used in combination with MSF technology comprising UGF and SSF. This study shows that combining CF-UGF with MSF greatly contributed to the removal efficiency of the system without negatively affecting the biological activity of the treatment system in terms of the efficiency of microorganism removal in the UGF and SSF when coagulant was dosed. This strongly contributes
20 to the operational flexibility of the system as it allows to dose coagulant only when high influent turbidity peaks occur.

CF-UGF improved the operation of MSF compared to only UGF, when the system operated with turbidity levels above 30 NTU, facilitating the performance of the SSF by
25 reducing the load of particulate material to avoid short filter runs and possible inter-ruptions in treatment plant operation. The removal efficiency of turbidity in the CF-UGF

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



with coagulant dosing was between 85 and 96 %, which is higher compared to operation without coagulant dosing; average efficiency of turbidity in the CF-UGF was 46 %, ranging between 21–76 %. The addition of coagulant in the CF-UGF allowed for obtaining water with turbidity levels below 10 NTU after UGF, which contribute to the effective operation of the SSF. The overall system produced water with turbidity below 1 NTU for 98 % of the samples that were taken in the research period. In the operation with coagulant the removal efficiency for total coliforms, *E-coli* and HPC, was 2.75, 2.5 and 2.6 higher respectively compared to the operation without coagulant in the CF-UGF and UGF units. No reduction was observed in the microbial removal efficiency of the SSF, no obstruction of the SSF beds were demonstrated and SSF runs were maintained between 50 and 70 days for a maximum head loss of 0.70 m.

The hydraulic behaviour of CF-UGF indicated that the system worked with a plug flow fraction of 51 %, a mixed fraction of 46 % and a dead zone fraction of 3 %. The comparison between the theoretical model and experimental data indicated that hydraulic behaviour of the reactor CF-UGF tends to $n = 6$ reactors in series, confirming the presence of a relative plug flow. The mean residence time was 19.7 min for the operating flow of for the flow of 3 l s^{-1} ; theoretical retention time was 19 min.

It was only necessary to operate the system with coagulant for 20 % of the time. The CF-UGF run time was 6–100 h depending on raw water turbidity. In the operation without coagulant, the run time for the CF-UGF and UGF was 8 days. Whereas the designed drainage flow was established at 20 m h^{-1} in practice this level was not reached and the real flow according to the measurements in the units was about 9 m h^{-1} indicating that more research is needed on the effect of the drainage system during the cleaning operation.

The CF-UGF unit represented only 7 % of the total construction costs, and the pre-treatment CF-UGF and UGF represented 35 % of total costs, while the cost of m^3 produced by the MSF with the CF-UGF system was US \$ 0.05, for a per capita investment of US \$ 18. The O&M costs for the use of coagulant represented only 0.3 % of the total

O&M costs. The production cost was US \$0.264 m⁻³ for the operation with pumping. In a gravity system the cost is reduced to US \$0.14 per m³.

Acknowledgements. The authors acknowledge the support and trust received for the construction and evaluation system of the community and the governing board of Arroyo Hondo. The fieldwork was supported by Carlos Mejia (FHIS, IRC-YZ program) and Diana Posso (Sanitary Engineer program, Univalle) and plant operators Alfonso Escandón and Eulogio Mósquera. The financial support received by Cinara Institute, Universidad del Valle, research group in water supply, through of research station in Puerto Mallarino.

References

- Ahsan, T.: Process Analysis and Optimization of Direct Horizontal – Flow Roughing Filtration, Ph.D. thesis, Delft University of Technology, A.A. Balkema De, Rotterdam, The Netherlands, 193 pp., 1995.
- APHA, AWWA, and WPCF: Standard Methods for the examination of water and wastewater, USA, 21a Edn., 2005.
- Attakoya, A., Prasad, V. S., and Nagaraja, S. V.: Performance study of granulated flocculators, Indian Jour. Envir. HLTH., 33, 498–504, 1991.
- Bates, B. C., Kundzewicz, Z. W., Wu, S., and Palutikof, J. P. (Eds.): El Cambio Climático y el Agua, Documento técnico del Grupo Intergubernamental de Expertos sobre el Cambio Climático, Secretaría del IPCC, Geneva, 224 pp., 2008.
- Bhole, A. G.: Design and fabrication of a low cost water treatment plant for rural areas in India, Aqua, 5, 315–320, 1981.
- Burganos, V. N., Paraskeva, C. A., Christofides, P. D., and Payatakes, A. C.: Motion and deposition of non-Brownian particles in upflow collectors, Sep. Technol., 4, 47–54, 1994.
- Castro, M. L. and Pérez, J.: Procesos unitarios-ensayos de laboratorio, Programa regional OPS/EHP/CEPIS de mejoramiento de la calidad de agua para consumo humano, April, 61 pp., 1981.
- Centro Panamericano de Ingeniería Sanitaria y Ambiental – CEPIS: Tratamiento de agua para consumo humano, Filtración Rápida, Perú, 2004.

DWESD

5, 291–332, 2012

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

Cinara and International Development Research Centre, IDRC: Proyecto limpieza hidráulica de filtros gruesos, Final report, Cali, Colombia, 110 pp., 1993.

Cinara and IRC: Potencial de la filtración gruesa en múltiples etapas (FIGME) en la optimización de plantas de tratamiento con filtración rápida de agua químicamente coagulada, Cali, Colombia, 1996.

CGR, Contraloría General de la República: Estado de los Recursos Naturales y del Ambiente, República de Colombia, 180 pp., 2009.

Cleasby, J. L.: Source Water Quality and pretreatment option for slow sand filters, Chapter 3, in: Task committee on slow sand filters, New York, USA, 1991.

Di Bernardo, L.: Metodos e Técnicas de Tratamiento de Agua, Vol. I, ABES, Rio de Janeiro, Brasil, 481 pp., 1993.

Di Bernardo, L. and Cruz, C. H.: Influencia de altas tasas de filtración en el desempeño de sistemas de filtración directa ascendente, in: proceeding of XXIV Interamerican Congress of Ingeniería Sanitaria y Ambiental, Buenos Aires, Argentina, 1994.

Di Bernardo, L. and Sabogal, L. P.: Seleçãõ de tecnologias de tratamento de água, Editora LDIBE LTDA, Sao Carlos Brasil, I, 878 pp., 2009.

Dinoy, A. A.: Friction Factor and Reynolds Number Relationship in Flow through Porous Media, ME Thesis, AIT, Bangkok, Thailand, 1971.

Dorea, C. C. and Clarke, B. A.: Impact of chemical pretreatment in Slow Sand Filtration, in: proceeding of Recent progress in slow sand and alternative biofiltration processes, IWA publishing, 215–223, 2006.

Ergun, S.: Fluid Flow Through Packed Colum, Chem. Eng. Prog., 48, 2, 89–94, 1952.

Fair, G. M., Geyer, J. C., and Okun, D. A.: Purificación de aguas y tratamiento y remoción de aguas residuales, Fifth reprint, Editorial Limusa Mexico, Vol II, 764 pp., 1984.

Galvis, G.: Development and evaluation of multistage filtration plants; an innovative, robust and efficient water treatment technology, Ph.D. thesis, Guilford, UK, CEHE, University of Surrey, 228 pp., 1999.

Galvis, G. and Visscher, J. T.: Multi-stage filtration a life-saving technology, in: proceeding of the First International Symposium Technology, Operations and Economics of Providing Safe, Drinking Water in Small Systems, Washington, DC, USA, 10–13 May 1998.

Galvis, G., Latorre, J., and Visscher, J. T.: Filtración en múltiples etapas, tecnología innovativa para el tratamiento de agua, Universidad del Valle, Instituto Cinara, Cali, Colombia,

**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

International water and sanitation centre, IRC, The Netherlands, UNESCO, united nations office for science and culture, 197 pp., 1999.

Ives, K. J.: Testing of filter media, J. Water SRT, Aqua, 39, 144–151, 1990.

Kardile, J. L.: Development of simple and economic filtration methods for rural water supplies, Aqua-Fenicca, 1, 226–229, 1981.

Kawamura, S.: Two stage filtration, J. AWWA, 77, 42–47, 1985.

Lloyd, B. and Helmer, R.: Vigilancia y control de la calidad del agua para consumo humano en la zona rural, Published for the WHO and UNEP by Logman Scientific and Technical, 1991.

Ministerio de Desarrollo: Inventario nacional del sector de agua potable y saneamiento básico, Vol. I, Infraestructura física de los sistemas, Ministerio de Desarrollo Económico, Viceministerio de Desarrollo Urbano, Dirección de servicios públicos domiciliarios, Colombia, 13–67, 1998.

Pérez, J. and Galvis, G.: Análisis de flujos y factores que determinan los periodos de retención, Centro de Ingeniería Sanitaria y Ciencias del Ambiente, CEPIS, Organización Panamericana de la Salud, OPS Vol. II, 112 pp., 1990.

Richter, C.: Sistemas simplificados de floculación, in: Proceeding of Seminario Internacional sobre Tecnología Apropiada para Potabilización del Agua, ACODAL, seccional Valle del Cauca, Cali, Colombia, August 1987.

Richter, C. A. and Moreira, B. R.: Floculadores de Pedras. Experiencia en Filtro Piloto, Reporte interno Sanepar, Parana, Brasil, 1981.

Rocha, M. A., Normando, H., and Onofre, C.: Aplicação de tracadores em filtros anaeróbicos para avaliação das características hidrodinâmicas, in: Proceeding of XXVII Congresso Interamericano de Engenharia Sanitária e Ambiental, Porto Alegre, Brasil, Associação Brasileira de Engenharia Sanitária e Ambiental – Região Rio Grande do Sul (ABES/RS), 2000.

Salazar, M. and Ocampo, J.: Estudio sobre la eficiencia hidráulica y remoción de material suspendido en clarificadores ascendentes de gravas estratificadas, Universidad del Valle, Cali, Colombia, 1999.

Sánchez, L. D. and Galvis, G.: Tecnologías en abastecimiento de agua para pequeños sistemas de suministro de agua, in: Proceeding of the international conference AGUA 1998, Instituto Cinara, Cali, Colombia, 1998.

Santamaría, J.: Comparación de la floculación mecánica y la floculación en clarificadores ascendentes en gravas estratificadas, Universidad del Valle, Cali Colombia, 97 pp., 1999.

Title Page	
Abstract	Introduction
Conclusions	References
Tables	Figures
◀	▶
◀	▶
Back	Close
Full Screen / Esc	
Printer-friendly Version	
Interactive Discussion	

Table 1. Parameters and formulae.

Parameter	Formulae	Value
RMC		
Length to the mixing point	$L_m = 1 + 0.5h_v(P_v/h_v)^{0.54}$ (1)	0.17 m
Velocity gradient for rapid mixing	$G = (\gamma E_p/\mu T_m)^{0.5}$ (2)	1282 s ⁻¹
Average mixing time (T_m)	$T_m = L_r/V_{ap}$ (3)	0.31 s
CF-UGF		
Average velocity gradient CF-UGF (Di Bernardo, 1993)	$G = \sqrt{\frac{(\gamma)(V_{ap})(J_{mg})}{(\mu)(\epsilon_o)}}}$ (4)	28.5–3.1 s ⁻¹
Unit head loss in the porous medium (Ergun, 1952 and Di Bernardo, 1993)	$J = \frac{150\nu(1-\epsilon_o)^2(V_{ap})}{g(\epsilon_o)^3(D_{mg})^2} + \frac{1.75(1-\epsilon_o)(V_{ap})^2}{g(\epsilon_o)^3(C_o)(D_{mg})}$ (5)	0.0016–0.0009 m m ⁻¹
Reynolds number in the porous medium (Dinoy, 1971)	$R = \frac{\rho x V_{ax} k^{1/2}}{\mu}$ (6)	732–41

Where: L_r = hydraulic jump length; L_m = length between the base of the weir and the mixing point (m); h_v = table of water over the weir (m); P_v = height of water from the base of the weir and fill up sheet of water (m); E_p = loss of energy in the channel unit coagulation (m); T_m = average time of mixing (s); γ = specific weight of water (N m⁻¹); μ = absolute viscosity (N m s⁻²); V_{ap} = approach velocity (m s⁻¹); ϵ_o = porosity of clean filter; J = loss of unit load (m m⁻¹), ν = kinematic viscosity (m² s⁻¹). g = gravity constant (m s⁻²), C_o = coefficient of sphericity; D_{mg} = average grain size, ρ = density of water (kg m⁻³), Re = Reynolds number, k = permeability (cm⁻¹).



Low-cost multi-stage filtration

L. D. Sánchez et al.

Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper

[Title Page](#)

[Abstract](#) [Introduction](#)

[Conclusions](#) [References](#)

[Tables](#) [Figures](#)

[◀](#) [▶](#)

[◀](#) [▶](#)

[Back](#) [Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Table 2. Velocity gradients in the CF-UGF for the 2 flows of operation.

Filter media size mm	ε	D_{mg} (m)	Flow 3 l s ⁻¹				Flow 6 l s ⁻¹			
			V_{ap} (m s ⁻¹)	J (m m ⁻¹)	G s ⁻¹	Re	V_{ap} (m s ⁻¹)	J (m m ⁻¹)	G s ⁻¹	Re
31.7–19.0	0.31	0.0317	0.00375	0.0016	14.2	366	0.0075	0.0032	28.5	732
19.0–12.7	0.38	0.0191	0.0014	0.0007	5.3	124	0.0029	0.0015	11	257
12.7–9.5	0.40	0.0111	0.00075	0.0009	4.2	43	0.0015	0.0019	8.5	86
9.5–6.3	0.42	0.0079	0.00045	0.0009	3.1	20	0.0009	0.0018	6.3	41

$T = 22.8^\circ\text{C}$, $\gamma = 9737 \text{ N m}^{-1}$, $\mu = 9.44 \times 10^{-4} \text{ N m s}^{-2}$; $\nu = 9.47 \times 10^{-7} \text{ m}^2 \text{ s}^{-1}$, $C_o = 0.81$.



Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)

[Abstract](#) [Introduction](#)

[Conclusions](#) [References](#)

[Tables](#) [Figures](#)

[I◀](#) [▶I](#)

[◀](#) [▶](#)

[Back](#) [Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)

Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper

Table 3. Treatment barriers and design parameters.

Criteria	Treatment Stage				
	DRF	RMC	CF-UGF	UGF	SSF
Design period (years)	15	15	15	15	15
Operation time (h)	24	24	24	24	24
Number of units in parallel	2	1	2	2	4
Flow per unit (l s ⁻¹)	3	6	3	3	1.5
Filtration rate (m h ⁻¹)	3		3.2–27	0.9	0.30
Backwashing rate (m h ⁻¹)	20		20	20	
Area by unit (m ²)	3.6		2.1	10.8	18
Gravel					
Length (m)	0.6		1	1.1	0.2
Size (mm)	25.4–3.2		19–6.3	25.4–3.2	12.5
Sand					
Length (m)	–	–	–	–	0.85
<i>d</i> ₁₀ (mm)	–	–	–	–	0.15–0.35
<i>C_u</i>	–	–	–	–	2–3.5



Low-cost multi-stage filtration

L. D. Sánchez et al.

Table 4. Dimensions of each barrier.

Treatment barrier	Number of units	Dimensions			Flow (ls^{-1})	Material structure
		L (m)	A (m)	H (m)		
Input chamber	1	5.15	0.6	0.7	6.0	Concrete
DRF	2	4.0	0.9	0.8	3.0	Concrete
RMC	1	2.2	0.4	0.5–0.7	6.0	Concrete
CF-UGF*	2	2.0	2.0	1.4	3.0	Concrete
UGF	2	3.8	2.8	1.3	3.0	Concrete
SSF	4	3.7	4.7	1.75	1.5	Concrete

L : length; A : width; H : depth; * Bottom Area: 0.16 m^2 Surface Area: 4.0 m^2

[Title Page](#)
[Abstract](#)
[Introduction](#)
[Conclusions](#)
[References](#)
[Tables](#)
[Figures](#)
[Back](#)
[Close](#)
[Full Screen / Esc](#)
[Printer-friendly Version](#)
[Interactive Discussion](#)


Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Table 5. Water quality parameters and analysis method.

Parameters	Method	Limit of detection
Total coliform	9222B, filtration × membrane	0
<i>E-coli</i>	9222B, filtration × membrane	0
HPC	9215A, discharge in plate	0
Turbidity	2130B	0.1
Aluminium	3500-AI B	0.03
pH	4500 H +	2
True colour	2120C	1
TOC	5310 B	0.18

(APHA, AWWA, WPCF, 2005)

Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[I◀](#)

[▶I](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



Table 6. Procedure for the jar tests.

Test	Dose (mg l ⁻¹)	Coagulation time (s)	Slow mixing gradient (rpm)	Slow mixing time (min)	Sedimentation time (min)
1	10 20 30 40 50 60	60	40	25	15
2	3 7 10 13 17 20	60	40	25	15
3	Optimal test 1	10 20 30 40 50 60	40	25	15
4	Optimal test 2	10 20 30 40 50 60	40	25	15
5	Optimal test 1	Optimal test 3	20	5 10 20 25 30 40	15
6	Optimal test 2	Optimal test 4	30	5 10 20 25 30 40	15
7	Optimal test 1	Optimal test 3	40	5 10 20 25 30 40	15
8	Optimal test 2	Optimal test 4	50	5 10 20 25 30 40	15
9	Optimal test 1	Optimal test 3–4	Optimal 20–30	Optimal test 5–6	5 10 15 20 25 30
10	Optimal test 2	Optimal test 3–4	Optimal 40–50	Optimal test 7–8	5 10 15 20 25 30

Low-cost multi-stage filtration

L. D. Sánchez et al.

Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper

- [Title Page](#)
- [Abstract](#)
- [Introduction](#)
- [Conclusions](#)
- [References](#)
- [Tables](#)
- [Figures](#)
- [I◀](#)
- [▶I](#)
- [◀](#)
- [▶](#)
- [Back](#)
- [Close](#)
- [Full Screen / Esc](#)
- [Printer-friendly Version](#)
- [Interactive Discussion](#)



Table 7. Microbiological behaviour without the use of coagulant (UGF: $V_f = 0.9 \text{ m h}^{-1}$, SSF: $V_f = 0.30 \text{ m h}^{-1}$).

Descriptive statistics	Raw water			CF-UGF and UGF effluent			SSF effluent		
	TC	EC	HPC	TC	EC	HPC	TC	EC	HPC
No data	9	9	7	9	9	7	10	10	9
Average	15 131	2262	202 629	12 227	2161	139 625	12	0	744
Maximum	25 000	3600	403 500	19 400	6700	272 000	68	0	1900
Minimum	8000	1250	120 000	6100	800	73 000	2	0	100
STD deviation	6733	914	123 549	5893	1859	80 237	19.7	0	651.6
Average log removal units				0.16	0.16	0.17	3.3	3.2	2.3

TC: Total coliforms (CFU (100 ml)⁻¹) EC: *E-coli* (CFU (100 ml)⁻¹) HPC: heterotrophic play count bacteria (CFU (100 ml)⁻¹), operational flow 6 ls⁻¹.

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract Introduction

Conclusions References

Tables Figures

◀ ▶

◀ ▶

Back Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper | Discussion Paper

Table 8. Microbiological behaviour with the use of coagulant (UGF: V_f 0.9 m h⁻¹, SSF: V_f 0.3 m h⁻¹).

Descriptive statistics	Raw water			CF-UGF and UGF effluent			SSF effluent		
	TC	EC	HPC	TC	EC	HPC	TC	EC	HPC
No data	5	5	5	5	5	5	5	5	5
Average	13 240	2780	110 740	6070	1125	41 100	2.8	0	540
Maximum	16 050	5600	160 000	10 100	2150	47 100	4	0	800
Minimum	8900	1200	79 300	3900	1000	35 000	1	0	200
STD deviation	2746	1684	31 494	2402	465	5290	1.3	0	219
Average log CFU 100 ⁻¹ ml ⁻¹ removal units				0.44	0.40	0.44	3.4	3.1	3.9

TC: Total coliforms (CFU (100 ml)⁻¹); EC: *Escherichia coli* (CFU (100 ml)⁻¹); HPC: heterotrophic play count bacteria (CFU (100 ml)⁻¹), operational flow 6 l s⁻¹



Table 9. Summary of operating and monitoring conditions.

Variable	Value
Operational parameters	
Influent turbidity for coagulant dosing	> 30 NTU
Maximum turbidity of operation	Normally 100 NTU, sometimes can operate with peaks above 100 NTU for short periods of time (4–6 h).
Cleaning period CF-UGF and UGF, operation without coagulant.	Each 8 days
Time cleaning of CF-UGF	15 min
Time cleaning of UGF	45 min
Monitoring parameters	
Coagulant used	Liquid aluminium sulphate, type A, 50 % concentration
Filtration run of the CFUGF with application of coagulant	6–100 h
Percentage of time with coagulant dosage	20 % yr
Percentage of operating time without coagulant	80 % yr
Maximum period of time recorded dosing coagulant	100 h
Maximum duration of registered plant shutdown	24 h
Percentage of stops in the year	3 %
Maximum head loss in CF-UGF units	20 cm
Maximum head loss in UGF units	15 cm
Maximum backwashing rate CF-UGF	9.1 to 7.5 m h ⁻¹
Maximum backwashing rate UGF	9.4 to 8.4 m h ⁻¹

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[I◀](#)

[▶I](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



Table 10. Initial investment costs.

Stage of treatment	*Cost (US \$)	%
DRF	9821	16
CFUGF	4554	7
UGF	17 002	28
SSF	29 783	49
Total cost (US \$)*	61 160	
Cost l s ⁻¹ (US \$)	10 193	
Per capita cost (US \$)	18	

* Costs up to February 2011.

Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)

[Abstract](#)

[Introduction](#)

[Conclusions](#)

[References](#)

[Tables](#)

[Figures](#)

[I◀](#)

[▶I](#)

[◀](#)

[▶](#)

[Back](#)

[Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



Table 11. Operation and maintenance costs.

Item	Monthly cost (US \$)	%
Cost of coagulant (aluminium sulphate)	13	0.3
Cost of the chlorine	365	9.5
Staff costs (including benefits and social security)	1399	36.4
Electrical energy costs	1661	43.3
Costs of materials and equipment	249	6.5
Costs for water quality analysis	155	4
Total monthly cost O&M (US \$)	3842	
O&M costs per m ³ produced (US \$ m ⁻³)	0.25	

Note: all costs to December 2010.

**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

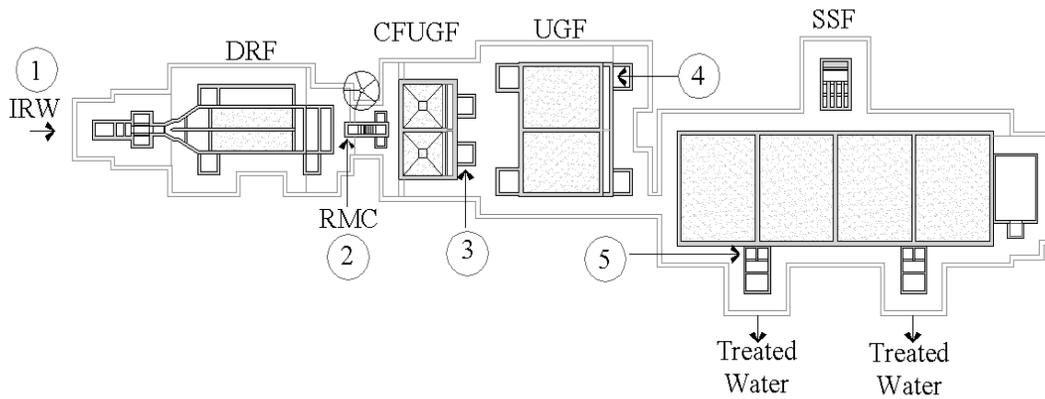


Fig. 1. Layout of the treatment system (1–5: monitoring points of water quality).

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[I◀](#)[▶I](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)

Low-cost multi-stage filtration

L. D. Sánchez et al.

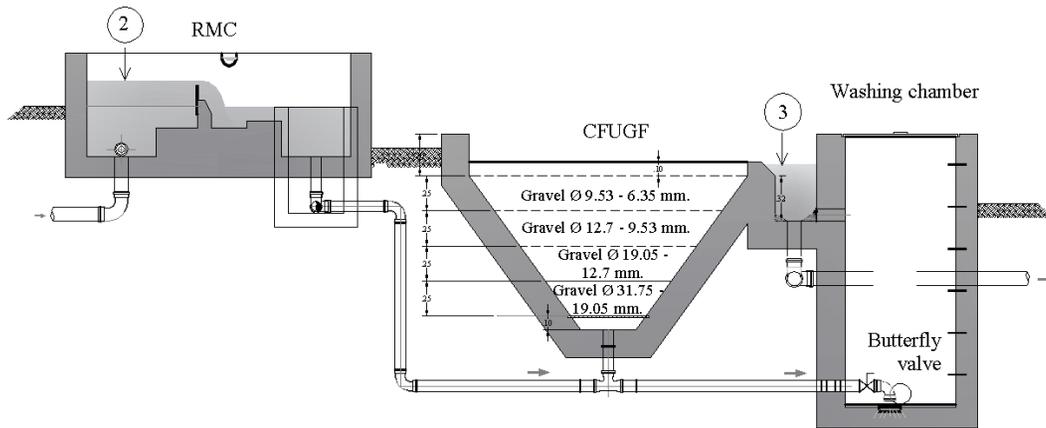


Fig. 2. CF-UGF Unit Scheme (2–3: monitoring points of water quality).

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶


Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion

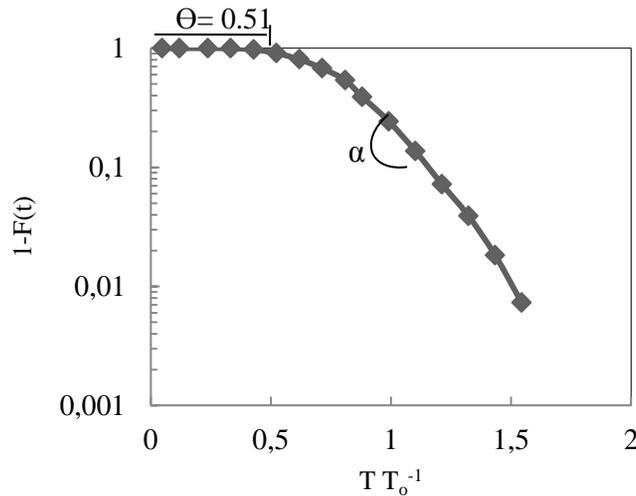

$$\text{Log } 1-F(t) = -0.95 (T/T_o) + 1.24 \quad (r^2 = 0,902)$$

$$\text{Tan}\alpha = 0.95; \Theta = 0.51; p = 0.53; m = 0.03; M_f = 0.46$$

Fig. 4. Hydraulic Wolf-Resnick model results for the CF-UGF.

Low-cost multi-stage filtration

L. D. Sánchez et al.

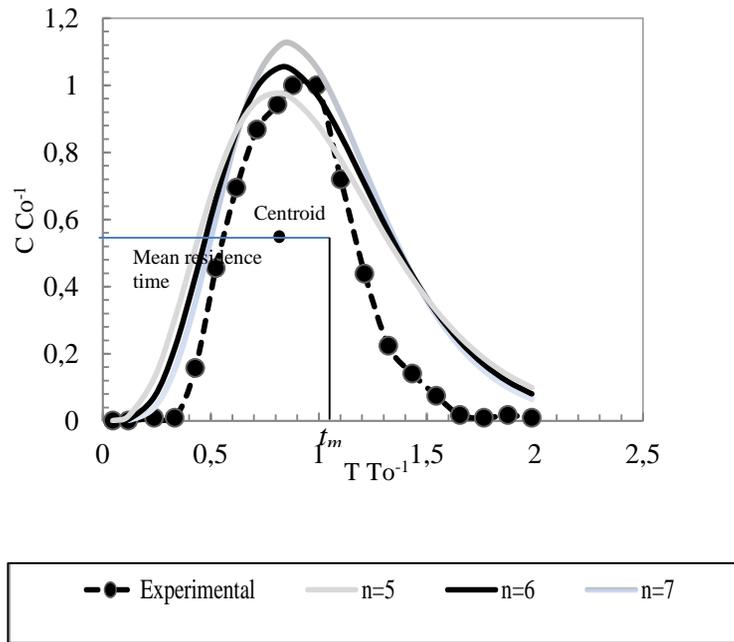


Fig. 5. CMRS model for CF-UGF.

Title Page

Abstract

Introduction

Conclusions

References

Tables

Figures

◀

▶

◀

▶

Back

Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



Low-cost multi-stage filtration

L. D. Sánchez et al.


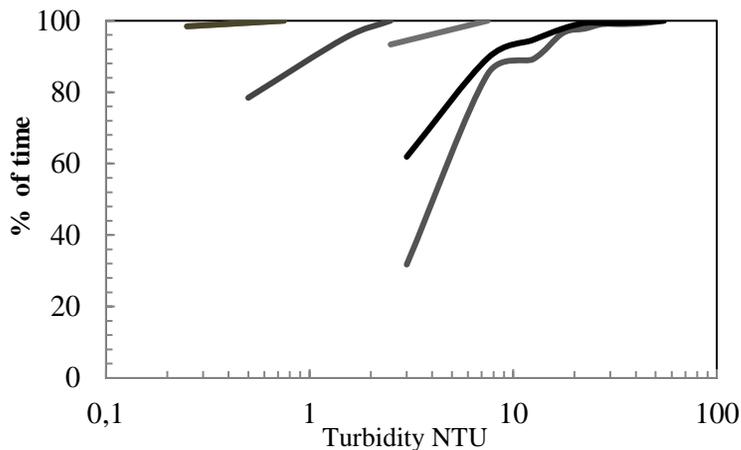


Fig. 6. Frequency of turbidity levels (operation without coagulant).

Title Page

Abstract Introduction

Conclusions References

Tables Figures

I◀ ▶I

◀ ▶

Back Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion




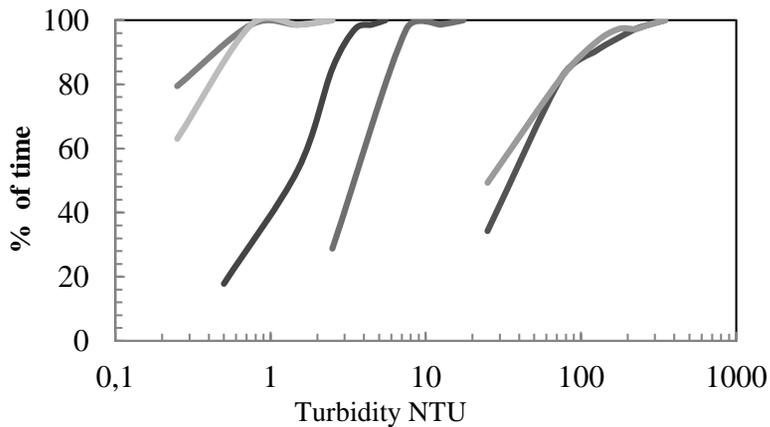


Fig. 7. Frequency of turbidity levels (operation with coagulant).

Low-cost multi-stage filtration

L. D. Sánchez et al.

[Title Page](#)

[Abstract](#) [Introduction](#)

[Conclusions](#) [References](#)

[Tables](#) [Figures](#)

[I◀](#) [▶I](#)

[◀](#) [▶](#)

[Back](#) [Close](#)

[Full Screen / Esc](#)

[Printer-friendly Version](#)

[Interactive Discussion](#)



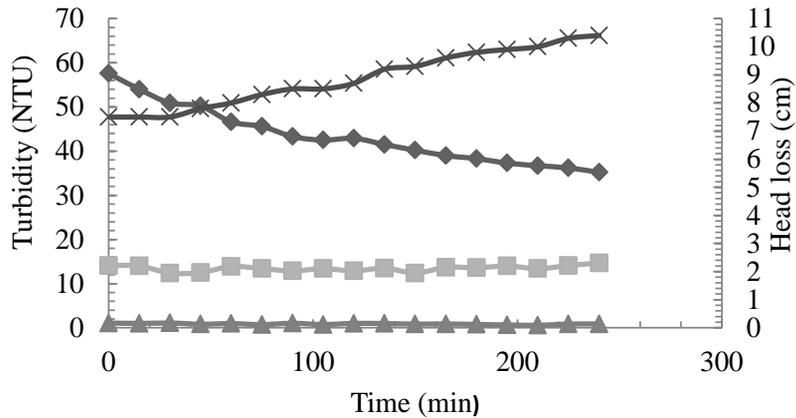


Fig. 8. Turbidity in CF-UGF and UGF units and head loss on CF-UGF.

Low-cost multi-stage filtration

L. D. Sánchez et al.

Title Page

Abstract Introduction

Conclusions References

Tables Figures

◀ ▶

◀ ▶

Back Close

Full Screen / Esc

Printer-friendly Version

Interactive Discussion



**Low-cost multi-stage
filtration**

L. D. Sánchez et al.

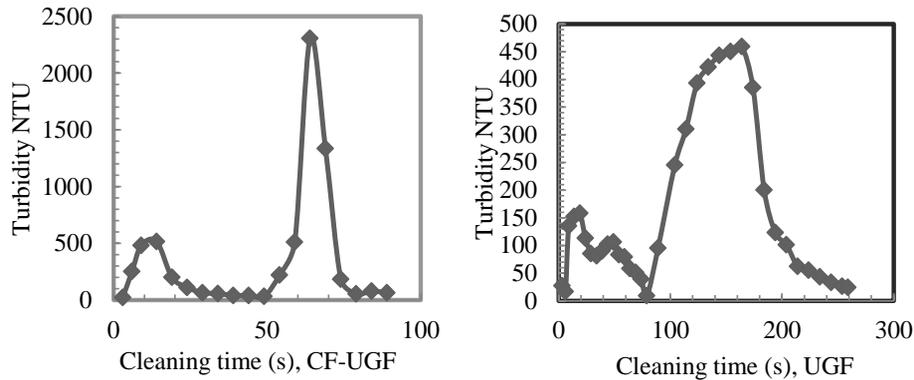


Fig. 9. Behaviour of turbidity on a deep clean-up of CF-UGF and UGF.

[Title Page](#)[Abstract](#)[Introduction](#)[Conclusions](#)[References](#)[Tables](#)[Figures](#)[◀](#)[▶](#)[◀](#)[▶](#)[Back](#)[Close](#)[Full Screen / Esc](#)[Printer-friendly Version](#)[Interactive Discussion](#)